

Transformer Thermal Impact Assessment White Paper (Draft)

Project 2013-03 (Geomagnetic Disturbance Mitigation)

TPL-007-1 Transmission System Planned Performance for Geomagnetic Disturbance Events

Background

On May 16, 2013, FERC issued Order No. 779, directing NERC to develop Standards that address risks to reliability caused by geomagnetic disturbances (GMDs) in two stages:

- Stage 1 Standard(s) that require applicable entities to develop and implement Operating Procedures. EOP-010-1 – Geomagnetic Disturbance Operations ~~was approved is pending at by~~ FERC in ~~Docket No. RM14-1-000~~ June 2014.
- Stage 2 Standard(s) that require applicable entities to conduct assessments of the potential impact of benchmark GMD events on their systems. If the assessments identify potential impacts, the Standard(s) will require the applicable entity to develop and implement a plan to mitigate the risk.

TPL-007-1 is a new Reliability Standard to specifically address the Stage 2 directives in Order No. 779.

Large power transformers connected to the EHV transmission system can experience both winding and structural hot spot heating as a result of GMD events. TPL-007-1 will require owners of such transformers to conduct thermal analyses of their transformers to determine if the transformers will be able to withstand the thermal transient effects associated with the Benchmark GMD event. This paper discusses methods that can be employed to conduct such analyses, including example calculations.

The primary impact of GMDs on large power transformers is a result of the quasi-dc current that flows through wye-grounded transformer windings. This geomagnetically-induced current (GIC) results in an offset of the ac sinusoidal flux resulting in asymmetric or half-cycle saturation (see **Figure 1**).

Half-cycle saturation results in a number of known effects:

- Hot spot heating of transformer windings due to harmonics and stray flux;
- Hot spot heating of non-current carrying transformer metallic members due to stray flux;
- Harmonics;
- Increase in reactive power absorption; and
- Increase in vibration and noise level.

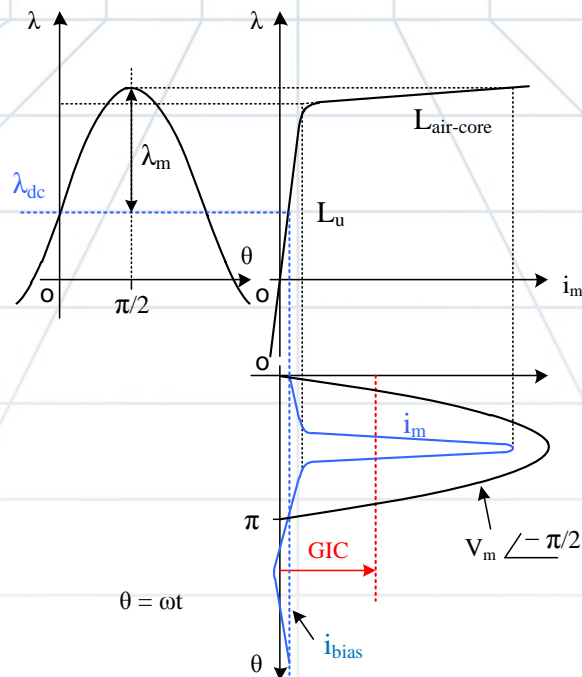


Figure 1: Mapping Magnetization Current to Flux through Core Excitation Characteristics

This paper focuses on hot spot heating of transformer windings and non current-carrying metallic parts. Effects such as the generation of harmonics, increase in reactive power absorption, vibration, and noise are not within the scope of this document.

Technical Considerations

The effects of half-cycle saturation on HV and EHV transformers, namely localized “hot spot” heating, are relatively well understood, but are difficult to quantify. A transformer GMD impact assessment must consider GIC amplitude, duration, and transformer physical characteristics such as design and condition (e.g., age, gas content, and moisture in the oil). A single threshold value of GIC cannot be justified as a “pass or fail” screening criterion where “fail” means that the transformer will suffer damage. A single threshold value of GIC only makes sense in the context where “fail” means that a more detailed study is required and that “pass” means that GIC in a particular transformer is so low that a detailed study is unnecessary. Such a threshold would have to be technically justifiable and sufficiently low to be considered a conservative value within the scope of the benchmark.

The following considerations should be taken into account when assessing the thermal susceptibility of a transformer to half-cycle saturation:

- In the absence of manufacturer specific information, use the temperature limits for safe transformer operation such as those suggested in the IEEE Std. C57.91-2011 standard [1] for hot spot heating during short-term emergency operation. This standard does not suggest that exceeding these limits will result in transformer failure, but rather that it will result in additional aging of cellulose in the paper-oil insulation, and the potential for the generation of gas bubbles in the bulk oil. Thus, from the point of view of evaluating

possible transformer damage due to increased hot spot heating, these thresholds can be considered conservative for a transformer in good operational condition.

- The worst case temperature rise for winding and metallic part (e.g., tie plate) heating should be estimated taking into consideration the construction characteristics of the transformer as they pertain to dc flux offset in the core (e.g., single-phase, shell, 5 and 3-leg three-phase construction).
- Bulk oil temperature due to ambient temperature and transformer loading must be added to the incremental temperature rise caused by hot spot heating. For planning purposes, maximum ambient and loading temperature should be used unless there is a technically justified reason to do otherwise.
- The time series or “waveshape” of the reference GMD event in terms of peak amplitude, duration, and frequency of the geoelectric field has an important effect on hot spot heating. Winding and metallic part hot spot heating have different thermal time constants, and their temperature rise will be different if the GIC currents are sustained for 2, 10, or 30 minutes for a given GIC peak amplitude.
- The “effective” GIC in autotransformers (reflecting the different GIC ampere-turns in the common and the series windings) must be used in the assessment. The effective current $I_{dc,eq}$ in an autotransformer is defined by [2]

$$I_{dc,eq} = I_H + (I_N / 3 - I_H) V_X / V_H \quad (1)$$

where,

I_H is the dc current in the high voltage winding;

I_N is the neutral dc current;

V_H is the rms rated voltage at HV terminals;

V_X is the rms rated voltage at the LV terminals.

Transformer Thermal Impact Assessment Process

There are two different ways to carry out a detailed thermal impact screening:

1. Transformer manufacturer GIC capability curves. These curves relate permissible peak GIC (obtained by the user from a steady-state GIC calculation) and loading_z for a specific transformer. An example of manufacturer capability curves is provided in **Figure 2**. Presentation details vary between manufacturers_z and limited information is available regarding the assumptions used to generate these curves, in particular_z the assumed waveshape or duration of the effective GIC. Some manufacturers assume that the waveshape of the GIC in the transformer windings is a square pulse of 2, 10, or 30 minutes in duration. In the case of the transformer capability curve shown in **Figure 2** [3], a square pulse of 900 A/phase with a duration of 2 minutes would cause the Flitch plate hot spot to reach a temperature of 180 °C at full load. While GIC capability curves are relatively simple to use, an fair amount of engineering judgment is necessary to ascertain what-which portion of a GIC waveshape is equivalent to, for instanceexample, a 2 minute pulse. Also, manufacturers generally maintain that in the absence of transformer standards defining thermal duty due to GIC, such capability curves have-to-must be developed for every transformer design and vintage.

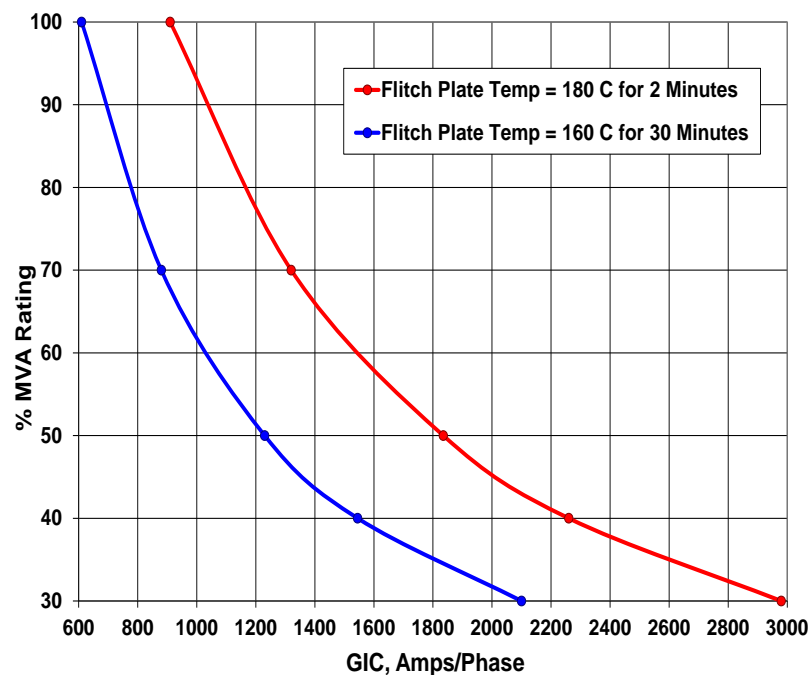


Figure 2: Sample GIC Manufacturer Capability Curve of a Large Single-Phase Transformer Design using the Flitch Plate Temperature Criteria [3]

2. Thermal response simulation¹. The input to this type of simulation is the time series or waveshape of effective GIC flowing through a transformer (taking into account the actual configuration of the system)_z and the result of the simulation is the hot spot temperature (winding or metallic part) time sequence for a given transformer. An example of GIC input and hotspot temperature time series values from [4] are shown in

¹ Technical details of this methodology can be found in [4].

Figure 3. The hot spot thermal transfer functions can be obtained from measurements or calculations provided by transformer manufacturers. Conservative default values can be used (e.g. those provided in [4]) when specific data are not available. Hot spot temperature thresholds shown in **Figure 3** are consistent with IEEE Std. C57.91 emergency loading hot spot limits. Emergency loading time limit is usually 30 minutes.

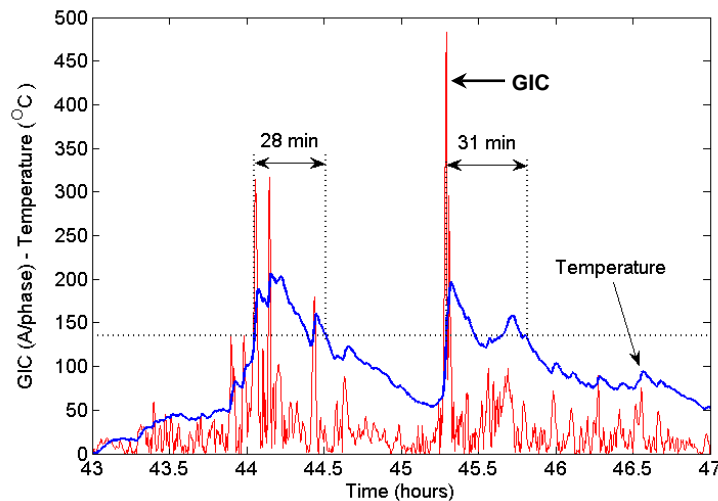


Figure 3: Sample Tie Plate Temperature Calculation

Blue trace is incremental temperature and red trace is the magnitude of the GIC/phase [4]

It is important to reiterate that the characteristics of the time sequence or “waveshape” are very important in the assessment of the thermal impact of GIC on transformers. Transformer hot spot heating is not instantaneous. The thermal time constants of transformer windings and metallic parts are typically on the order of minutes to tens of minutes; therefore, hot spot temperatures are heavily dependent on GIC history and rise time, amplitude and duration of GIC in the transformer windings, bulk oil temperature due to loading, ambient temperature and cooling mode.

Calculation of the GIC Waveshape for a Transformer

The following procedure can be used to generate time series GIC data, i.e. $GIC(t)$, using a software program capable of computing GIC in the steady-state. The steps are as follows:

1. Calculate contribution of GIC due to eastward and northward geoelectric fields for the transformer under consideration;
2. Scale the GIC contribution according to the reference geoelectric field time series to produce the GIC time series for the transformer under consideration.

Most available GIC-capable software packages can calculate GIC in steady-state in a transformer assuming a uniform eastward geoelectric field of 1 V/km (GIC_E) while the northward geoelectric field is zero. Similarly, GIC_N can be obtained for a uniform northward geoelectric field of 1 V/km while the eastward geoelectric field is zero. GIC_E and GIC_N are the normalized GIC contributions for the transformer under consideration.

If the earth conductivity is assumed to be uniform (or laterally uniform) in the transmission system of interest, then the transformer GIC (in A/phase/V/km) for any value of $E_E(t)$ and $E_N(t)$ can be calculated using (2) [2].

$$GIC(t) = |E(t)| \cdot \{GIC_E \sin(\varphi(t)) + GIC_N \cos(\varphi(t))\} \quad (2)$$

where

$$|E(t)| = \sqrt{E_N^2(t) + E_E^2(t)} \quad (3)$$

$$\varphi(t) = \tan^{-1}\left(\frac{E_E(t)}{E_N(t)}\right) \quad (4)$$

$$GIC(t) = E_E(t) \cdot GIC_E + E_N(t) \cdot GIC_N \quad (5)$$

GIC_N is the effective GIC due to a northward geoelectric field of 1 V/km, and GIC_E is the effective GIC due to an eastward geoelectric field of 1 V/km.

The geoelectric field time series $E_N(t)$ and $E_E(t)$ is obtained, for instance, from the reference geomagnetic field time series [5] after the appropriate geomagnetic latitude scaling factor α is applied². The reference geoelectric field time series is calculated using the reference earth model. When using this geoelectric field time series where a different earth model is applicable, it should be scaled with the conductivity scaling factor β ³. Alternatively, the geoelectric field can be calculated from the reference geomagnetic field time series after the appropriate geomagnetic latitude scaling factor α is applied and the appropriate earth model is used. In such case, the conductivity scaling factor β is not applied because it is already ~~taken into~~ accounted for by the use of the appropriate earth model.

Applying (5) to each point in $E_N(t)$ and $E_E(t)$ results in $GIC(t)$.

GIC(t) Calculation Example

Let us assume that from the steady-state solution, the effective GIC in this transformer is $GIC_E = -20$ A/phase if $E_N=0$, $E_E=1$ V/km and $GIC_N = 26$ A/phase if $E_N=1$ V/km, $E_E=0$. Let us also assume the geomagnetic field time series corresponds to a geomagnetic latitude where $\alpha = 1$ and that the earth conductivity corresponds to the reference earth model in [5]. The resulting geoelectric field time series is shown in **Figure 4**. Therefore:

$$GIC(t) = E_E(t) \cdot GIC_E + E_N(t) \cdot GIC_N \text{ (A/phase)}$$

$$GIC(t) = -E_E(t) \cdot 20 + E_N(t) \cdot 26 \text{ (A/phase)}$$

² The geomagnetic factor α is described in [2] and is used to scale the geomagnetic field according to geomagnetic latitude. The lower the geomagnetic latitude (closer to the equator), the lower the amplitude of the geomagnetic field.

³ The conductivity scaling factor β is described in [2] and is used to scale the geoelectric field according to the conductivity of different physiographic regions. Lower conductivity results in higher β scaling factors.

The resulting GIC waveshape $GIC(t)$ is shown in **Figures 5 and 6** and can subsequently be used for thermal analysis.

It should be emphasized that even for the same reference event, the $GIC(t)$ waveshape in every transformer will be different, depending on the location within the system and the number and orientation of the circuits connecting to the transformer station. Assuming a single generic $GIC(t)$ waveshape to test all transformers is incorrect.

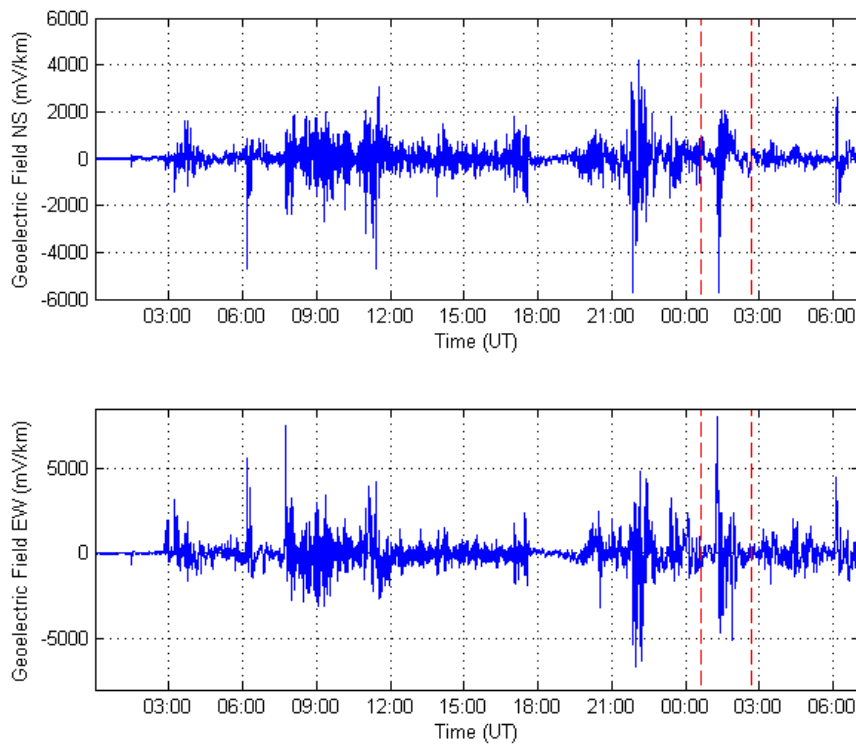


Figure 4: Calculated Goelectric Field $E_N(t)$ and $E_E(t)$ Assuming $\alpha=1$ and $\beta=1$ (Reference Earth Model). Zoom area for subsequent graphs is highlighted. Dashed lines approximately show the close-up area for subsequent Figures.

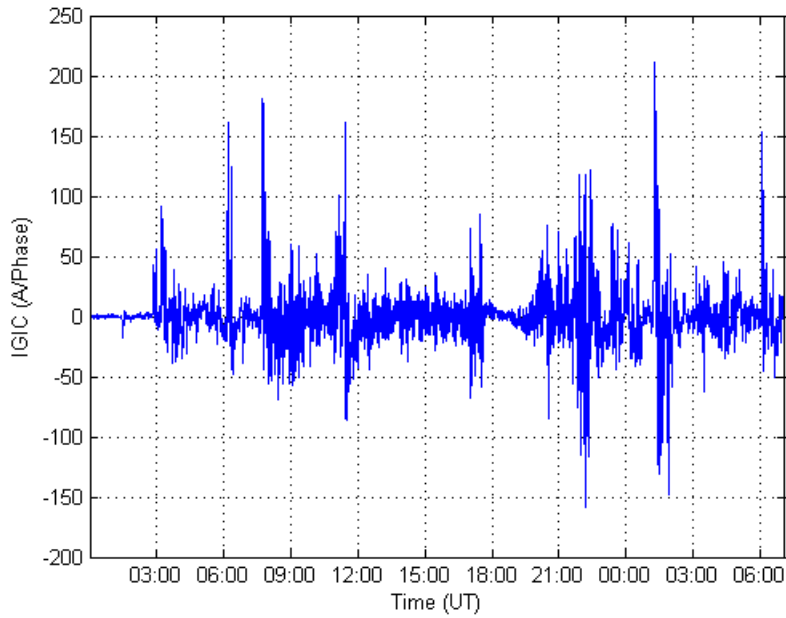


Figure 5: Calculated GIC(t) Assuming $\alpha=1$ and $\beta=1$ (Reference Earth Model)

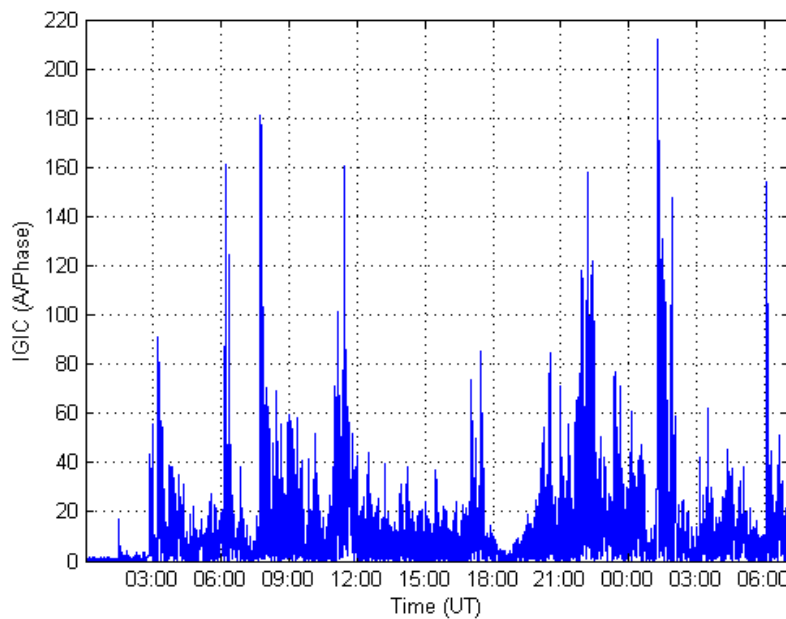


Figure 6: Calculated Magnitude of GIC(t) Assuming $\alpha=1$ and $\beta=1$ (Reference Earth Model)

Transformer Thermal Assessment Examples

There are two basic ways to carry out a transformer thermal analysis once the GIC time series $GIC(t)$ is known for a given transformer: 1) calculating the thermal response as a function of time; and 2) using manufacturer's capability curves.

Example 1: Calculating thermal response as a function of time using a thermal response tool

The thermal step response of the transformer can be obtained for both winding and metallic part hot spots from: -1) measurements; 2) manufacturer's calculations; or 3) generic published values. **Figure 7** shows the measured metallic hot spot thermal response to a dc step of 16.67 A/phase of the top yoke clamp from [6] that will be used in this example. **Figure 8** shows the measured incremental temperature rise (asymptotic response) of the same hot spot to long duration GIC steps.⁴

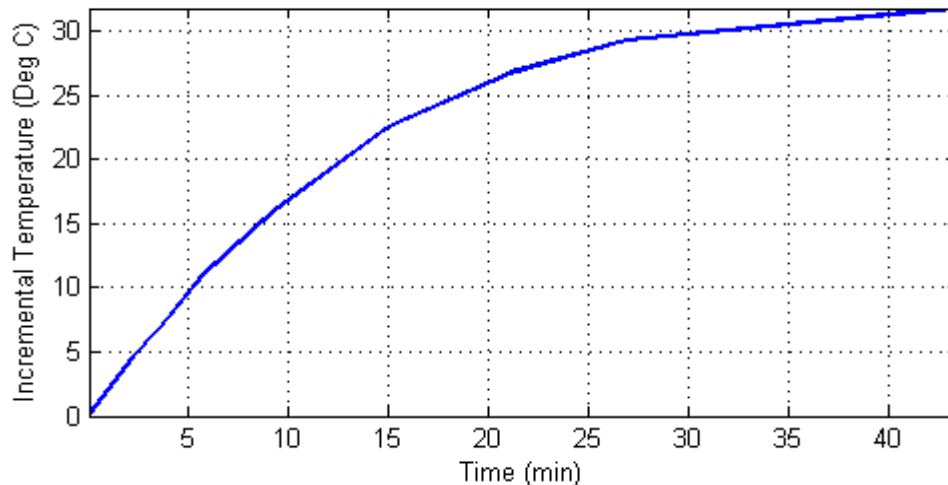


Figure 7: Thermal Step Response to a 16.67 Amperes per Phase dc Step
Metallic hot spot heating.

⁴ The heating of the bulk oil due to the hot spot temperature increase is not included in the asymptotic response because the time constant of bulk oil heating is at least an order of magnitude larger than the time constants of hot spot heating.

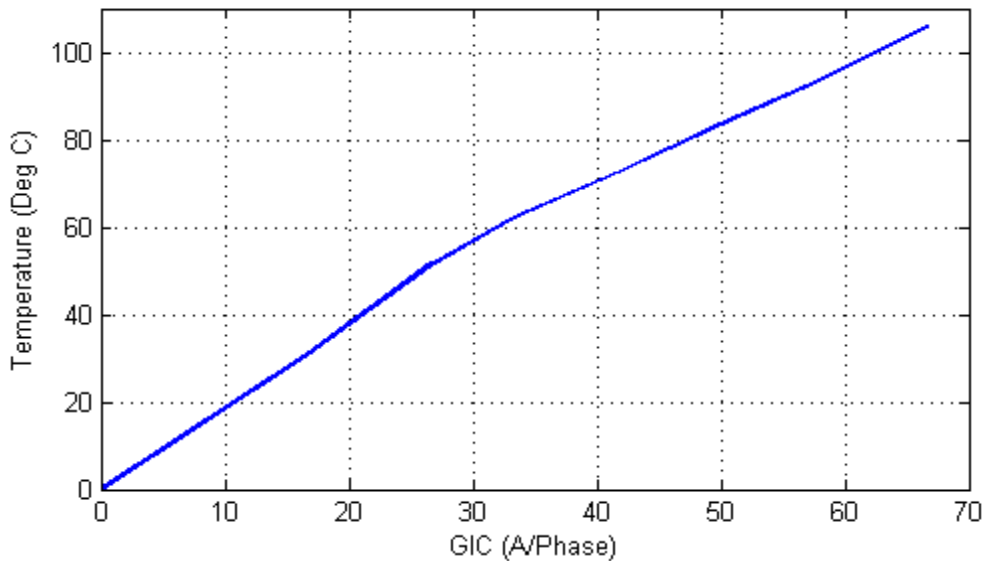


Figure 8: Asymptotic Thermal Step Response
Metallic hot spot heating.

The step response in **Figure 7** was obtained from the first GIC step of the tests carried out in [6]. The asymptotic thermal response in **Figure 8** was obtained from the final or near-final temperature values after each subsequent GIC step. **Figure 9** shows a comparison between measured temperatures and the calculated temperatures using the thermal response model used in the rest of this discussion.

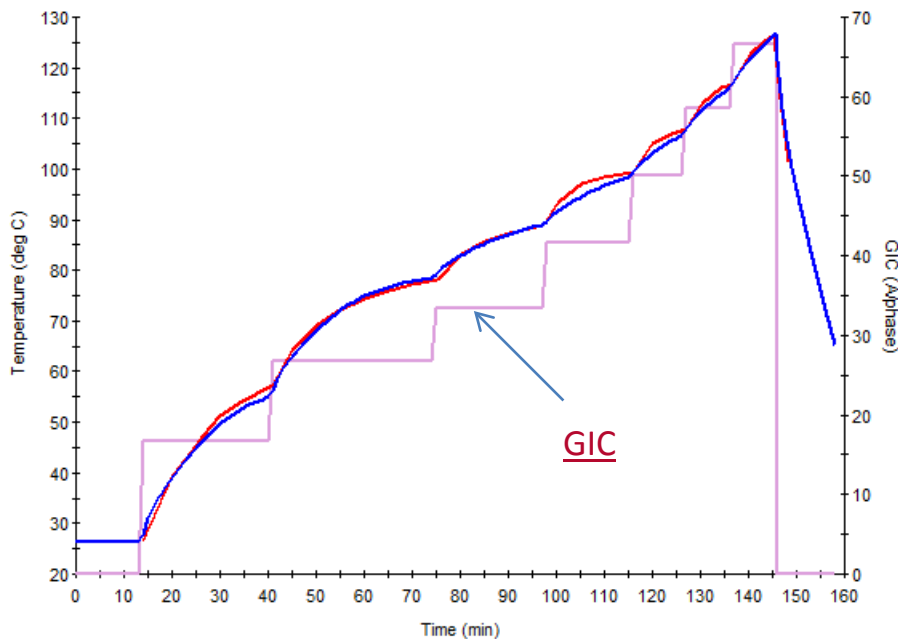


Figure 9: Comparison of measured temperatures (red trace) and simulation results (blue trace). Magenta trace is the injected current is represented by the magenta trace.

In order to obtain the thermal response of the transformer to a GIC waveshape such as the one in **Figure 6**, a thermal response model is required. To create a thermal response model, the measured or manufacturer-calculated transformer thermal step responses (winding and metallic part) for various GIC levels are required. The GIC(t) time series or waveshape is then applied to the thermal model to obtain the incremental temperature rise as a function of time $\theta(t)$ for the GIC(t) waveshape. The total temperature is calculated by adding the oil temperature, for example, at full load.

Figure 9-10 shows/illustrates the calculated GIC(t) and the corresponding hot spot temperature time series $\theta(t)$. **Figure 10-11** shows/illustrates a close-up view of the peak transformer temperatures calculated in this example.

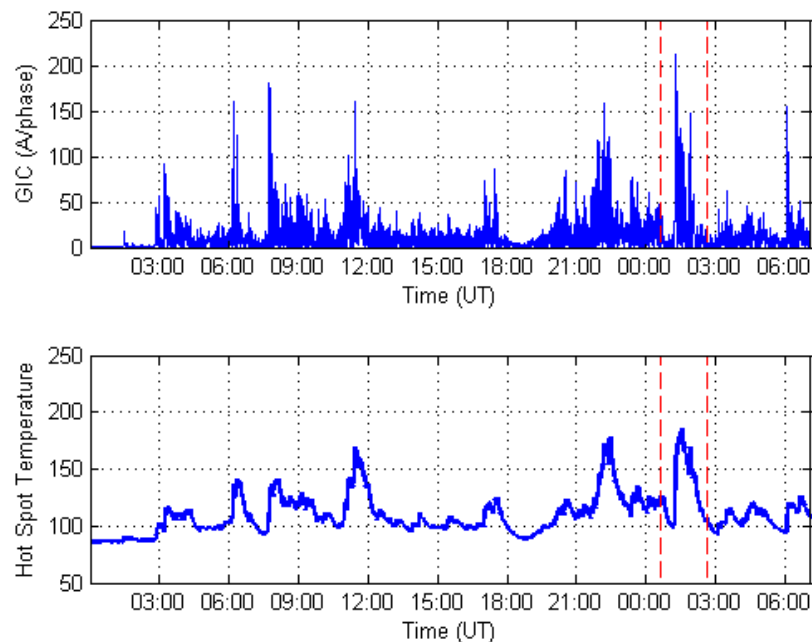


Figure 9-10: Magnitude of GIC(t) and Metallic Hot Spot Temperature $\theta(t)$ Assuming Full Load Oil Temperature of 85.3°C (40°C ambient). Dashed lines approximately show the close-up area for subsequent Figures.

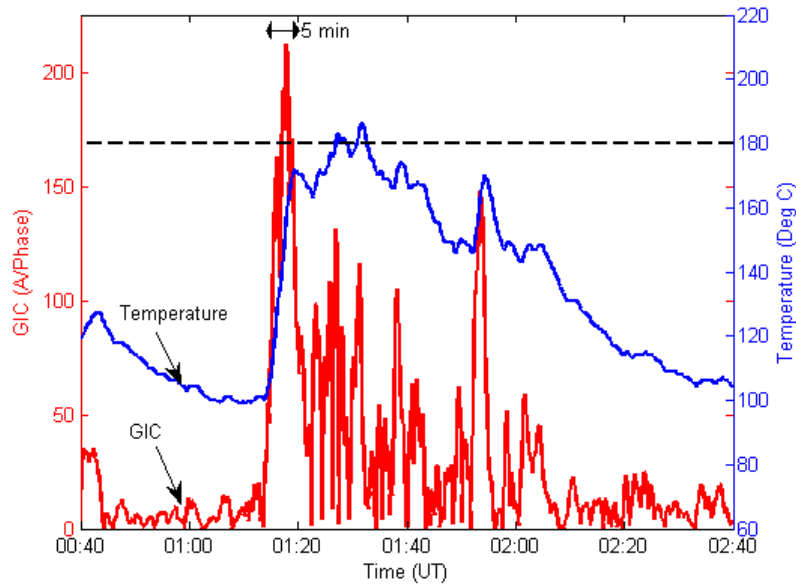


Figure 10-11: Close-up of Metallic Hot Spot Temperature Assuming a Full Load
(Blue trace is $\theta(t)$. Red trace is $GIC(t)$)

In this example, the IEEE Std. C57.91 emergency loading hot spot threshold of 200°C for metallic hot spot heating is not exceeded. Peak temperature is 186°C. The IEEE standard is silent as to whether the temperature can be higher than 200°C for less than 30 minutes. Manufacturers can provide guidance on individual transformer capability.

It is not unusual to use a lower temperature threshold of 180°C to account for calculation and data margins, as well as transformer age and condition. **Figure 10-11** shows that 180°C will be exceeded for 5 minutes.

At 75% loading, the initial temperature is 64.6 °C rather than 85.3 °C, and the hot spot temperature peak is 165°C, well below the 180°C threshold (see **Figure 11-12**).

If a conservative threshold of 160°C were ~~to be~~ used to ~~take into account~~ for the age and condition of the transformer, then the full load limits would be exceeded for approximately 22 minutes.

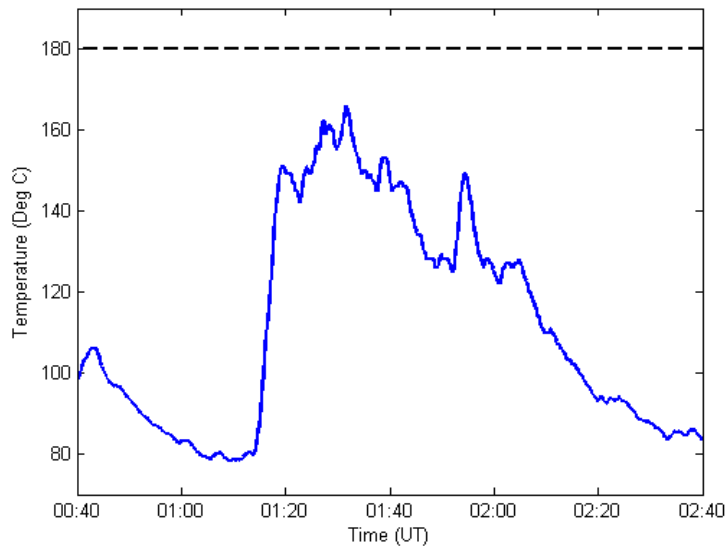


Figure 14-12: Close-up of Metallic Hot Spot Temperature Assuming a 75% Load (Oil temperature of 64.5°C)

Example 2: Using a Manufacturer’s Capability Curves

The capability curves used in this example are shown in **Figure 12-13**. To be consistent/maintain consistency with the previous example, these particular capability curves have been reconstructed from the thermal step response shown in **Figures 8-7** and **98**, and the simplified loading curve shown in **Figure 14-13** (calculated using formulas from IEEE Std. C57.91).

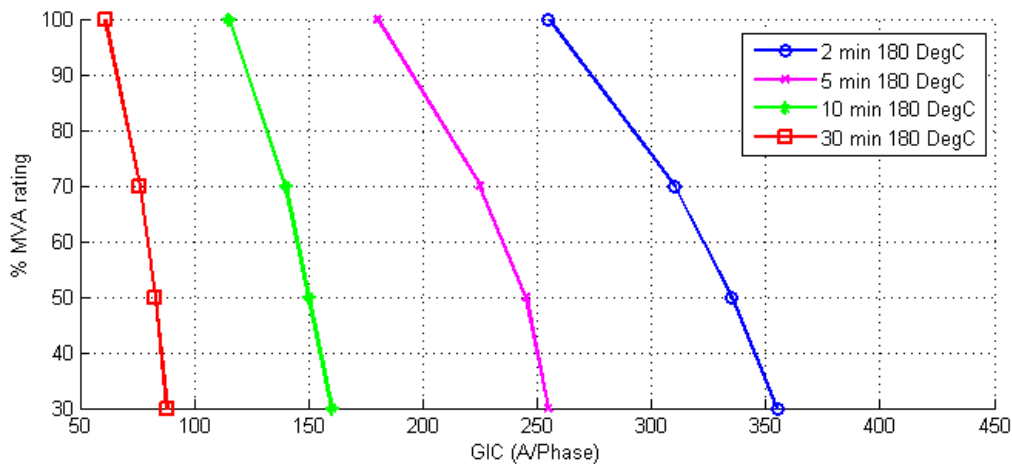


Figure 12-13: Capability Curve of a Transformer Based on the Thermal Response Shown in Figures 8 and 9.

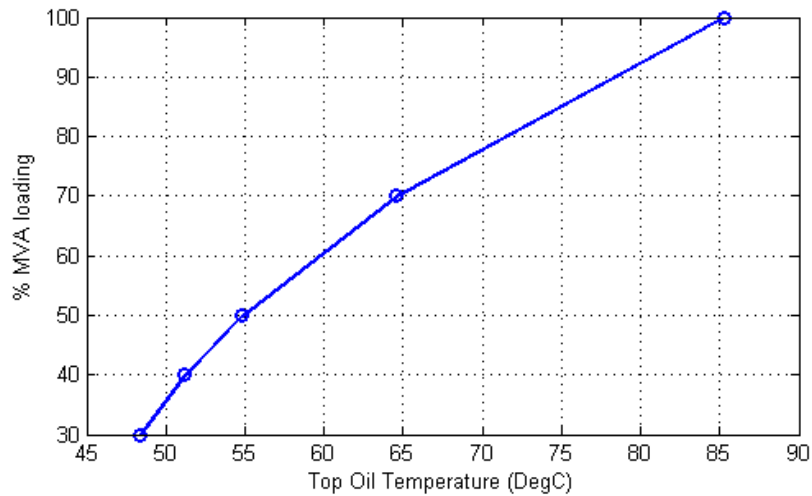


Figure 14-14: Simplified Loading Curve Assuming 40°C Ambient Temperature.

The basic notion behind the use of capability curves is to compare the calculated GIC in a transformer with the limits at different GIC pulse widths. A narrow GIC pulse has a higher limit than a longer duration or wider one. If the calculated GIC and assumed pulse width falls below the appropriate pulse width curve, then the transformer is within its capability.

To use these curves, it is necessary to estimate an equivalent square pulse that matches the waveshape of GIC(t), generally at a GIC(t) peak. **Figure 14-15** shows a close-up of the GIC near its highest peak superimposed to a 255 Amperes per phase, 2 minute pulse at 100% loading from **Figure 12-13**. Since a narrow 2-minute pulse is not representative of GIC(t) in this case, a 5 minute pulse with an amplitude of 180 A/phase at 100% loading has been superimposed on **Figure 15-16**. It should be noted that a 255 A/phase, 2 minute pulse is equivalent to a 180 A/phase 5 minute pulse from the point of view of transformer capability. Deciding what GIC pulse is equivalent to the portion of GIC(t) under consideration is a matter of engineering judgment.

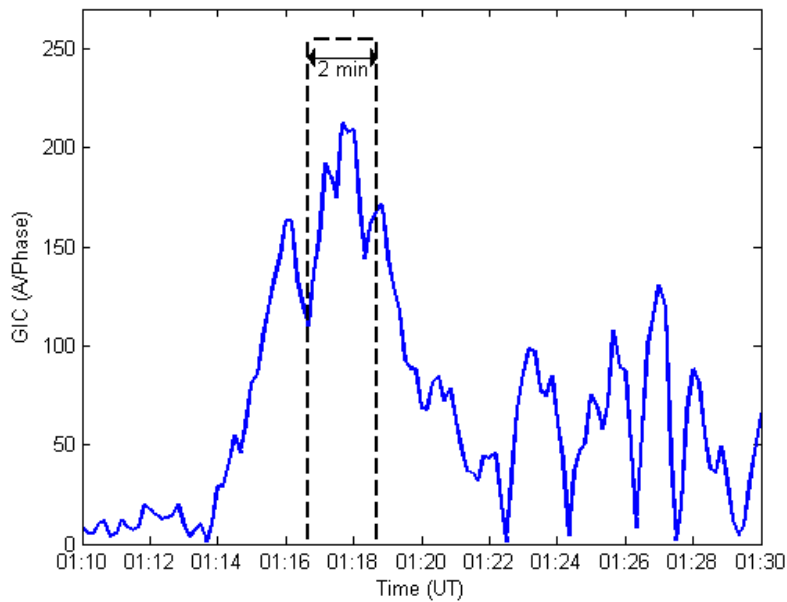


Figure 4415: Close-up of GIC(t) and a 2 minute 255 A/phase GIC pulse at full load

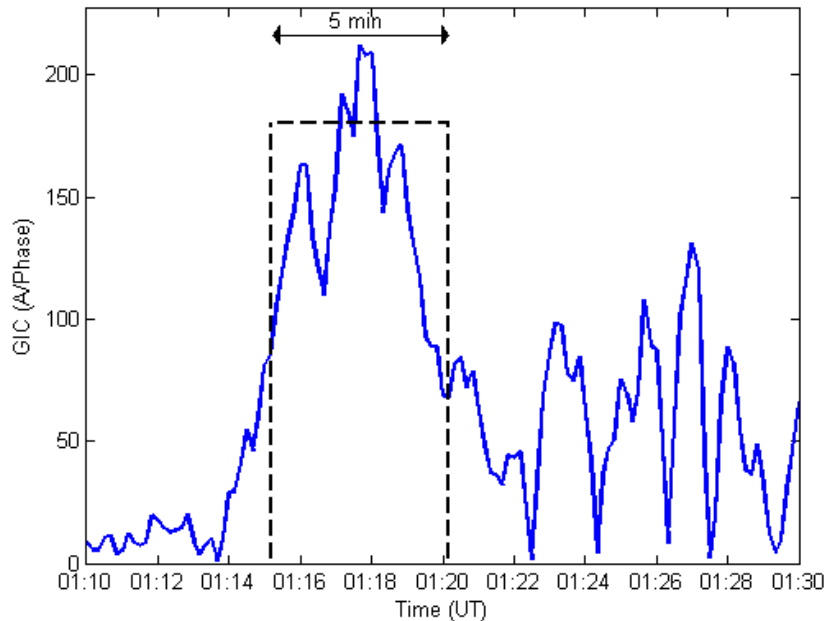


Figure 4516: Close-up of GIC(t) and a Five Minute 180 A/phase GIC Pulse at Full Load

When using a capability curve, it should be understood that the curve is derived assuming that there is no hot spot heating due to prior GIC at the time the GIC pulse occurs (only an initial temperature due to loading). Therefore, in addition to estimating the equivalent pulse that matches GIC(t), allowances have to be made in terms of prior hot

spot heating must be accounted for. From these considerations, it is unclear whether the capability curves would be exceeded at full load with a 180 °C threshold in this example.

At 70% loading, the two and five minute pulses from **Figure 12-13** would have amplitudes of 310 and 225 A/phase, respectively. The 5 minute pulse is illustrated in **Figure 1617**. In this case, judgment is also required to assess if the GIC(t) is within the capability curve for 70% loading. In general, capability curves are easier to use when GIC(t) is substantially above, or clearly below the GIC thresholds for a given pulse duration.

If a conservative threshold of 160°C were ~~to be used to take into account~~ for the age and condition of the transformer, then a new set of capability curves would be required.

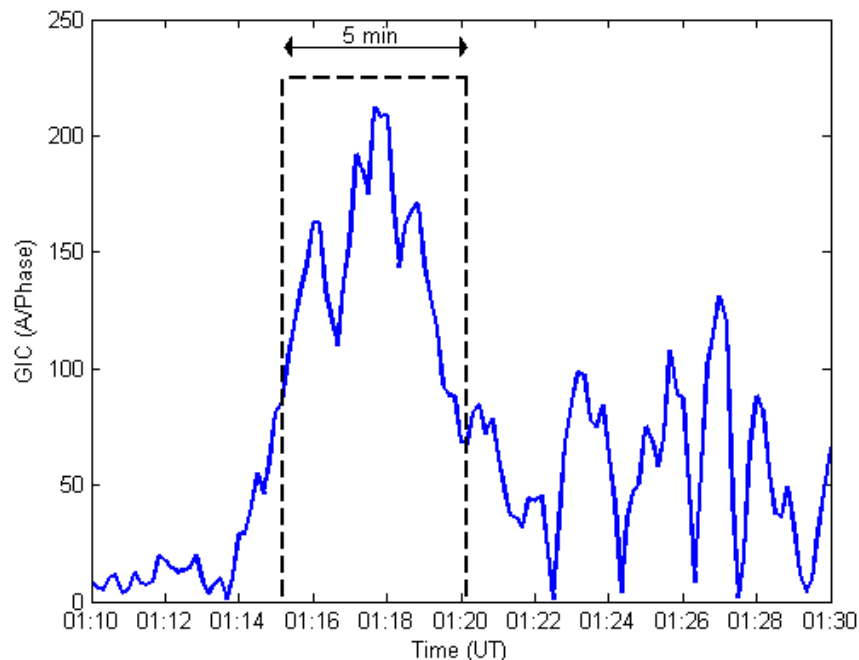


Figure 1617: Close-up of GIC(t) and a 5 Minute 225 A/phase GIC Pulse Assuming 75% Load

References

- [1] "IEEE Guide for loading mineral-oil-immersed transformers and step-voltage regulators." IEEE Std C57.91-2011 (Revision of IEEE Std C57.91-1995).
- [2] Application Guide: Computing Geomagnetically-Induced Current in the Bulk-Power System, NERC. Available at:
http://www.nerc.com/comm/PC/Geomagnetic%20Disturbance%20Task%20Force%20GMDTF%202013/GIC%20Application%20Guide%202013_approved.pdf
- [3] Girgis, R.; Vedante, K. "Methodology for evaluating the impact of GIC and GIC capability of power transformer designs." IEEE PES 2013 General Meeting Proceedings. Vancouver, Canada.
- [4] Marti, L., Rezaei-Zare, A., Narang, A. -"Simulation of Transformer Hotspot Heating due to Geomagnetically Induced Currents." IEEE Transactions on Power Delivery, vol.28, no.1. pp 320-327. January 2013.
- [5] Benchmark Geomagnetic Disturbance Event Description white paper. Developed by the Project 2013-03 (Geomagnetic Disturbance) standard drafting team. Available at:
<http://www.nerc.com/pa/Stand/Pages/Project-2013-03-Geomagnetic-Disturbance-Mitigation.aspx>
- [6] Lahtinen, Matti. -Jarmo Elovaara. "GIC occurrences and GIC test for 400 kV system transformer". IEEE Transactions on Power Delivery, Vol. 17, No. 2. April 2002.