

NERC

NORTH AMERICAN ELECTRIC
RELIABILITY CORPORATION

Frequency Response Standard Background Document

November, 2012

RELIABILITY | ACCOUNTABILITY



3353 Peachtree Road NE
Suite 600, North Tower
Atlanta, GA 30326
404-446-2560 | www.nerc.com

Table of Contents

- Table of Contents 1
- Introduction 2
- Background 2
- Rationale by Requirement 22
 - Requirement 1 22
 - Background and Rationale 22
 - Requirement 2 32
 - Background and Rationale 32
 - Requirement 3 34
 - Background and Rationale 35
 - Requirement 4 34
 - Background and Rationale 35
- How this Standard Meets the FERC Order No. 693 Directives 36
 - FERC Directive 36
 - 1. Levels of Non-Compliance 36
 - 2. Determine the appropriate periodicity of frequency response surveys necessary to ensure that Requirement R2 and other Requirements of the Reliability Standard are met ... 36
 - 3. Define the necessary amount of Frequency Response needed for Reliable Operation for each Balancing Authority with methods of obtaining and measuring that the frequency response is achieved 36
 - Necessary Amount of Frequency Response 36
 - Methods of Obtaining Frequency Response 37
 - Measuring that the Frequency Response is Achieved 37
 - Going Beyond the Directive 38
- Good Practices and Tools 39
 - Background 39
 - Identifying and Estimating Frequency Responsive Reserves 39
 - Using FRS Form 1 Data 40
 - Tools 40

Introduction

This document provides background on the development, testing and implementation of BAL-003-1 - Frequency Response Standard (“FRS”).¹ The intent is to explain the rationale and considerations for the Requirements of this standard and their associated compliance information. The document also provides good practices and tips for Balancing Authorities (“BAs”) with regard to Frequency Response.

In Order No. 693, the Federal Energy Regulatory Commission (“FERC” or the “Commission”) directed additional changes to BAL-003.² This document explains how compliance with those directives are met by BAL-003-1.

The original Standards Authorization Request (“SAR”), finalized on June 30, 2007, assumed there was adequate Frequency Response in all the North American Interconnections. The goal of the SAR was to update the Standard to make the measurement process of frequency response more objective and to provide this objective data to Planners and Operators for improved modeling. The updated models will improve understanding of the trends in Frequency Response to determine if reliability limits are being approached. The Standard would also lay the process groundwork for a transition to a performance-based Standard if reliability limits are approached.

This document will be periodically updated by the FRS Drafting Team (“FRSDT”) until the Standard is approved. Once approved, this document will then be maintained and updated by the ERO and the NERC Resources Subcommittee to be used as a reference and training resource.

Background

This section discusses the different components of frequency control and the individual components of Primary Frequency Control also known as Frequency Response.

Frequency Control

Most system operators generally have a good understanding of frequency control and Bias Setting as outlined in the balancing standards and the references to them in the [NERC Operating Manual](#). Frequency control can be divided into four overlapping windows of time as outlined below.

Primary Frequency Control (Frequency Response) – Actions provided by the Interconnection to arrest and stabilize frequency in response to frequency deviations.

¹ Unless otherwise designated herein, all capitalized terms shall have the meaning set forth in the Glossary of Terms Used in NERC Reliability Standards, available here: http://www.nerc.com/files/Glossary_of_Terms.pdf.

² *Mandatory Reliability Standards for the Bulk-Power System*, Order No. 693, FERC Stats. & Regs. ¶ 31,242 at PP 368-375, *order on reh’g*, Order No. 693-A, 120 FERC ¶ 61,053 (2007).

Primary Control comes from automatic generator governor response (also known as speed regulation), load response (typically from motors), and other devices that provide an immediate response based on local (device-level) control systems.

Secondary Frequency Control – Actions provided by an individual BA or its Reserve Sharing Group to correct the resource – load unbalance that created the original frequency deviation, which will restore both Scheduled Frequency and Primary Frequency Response. Secondary Control comes from either manual or automated dispatch from a centralized control system.

Tertiary Frequency Control – Actions provided by Balancing Authorities on a balanced basis that are coordinated so there is a net zero effect on Area Control Error (ACE). Examples of Tertiary Control include dispatching generation to serve native load; economic dispatch; dispatching generation to affect Interchange; and re-dispatching generation. Tertiary Control actions are intended to replace Secondary Control Response by reconfiguring reserves.

Time Control includes small offsets to scheduled frequency to keep long term average frequency at 60 Hz.

Primary Frequency Control – Frequency Response

Primary Frequency Control, also known generally as **Frequency Response**, is the first stage of overall frequency control and is the response of resources and load to a locally sensed change in frequency in order to arrest that change in frequency. Frequency Response is automatic, not driven by any centralized system, and begins within seconds rather than minutes. Different resources, loads, and systems provide Frequency Response with different response times, based on current system conditions such as total resource/load and their respective mix.


The proposed NERC Glossary of Terms defines **Frequency Response** as:

- (Equipment) The immediate and automatic reaction or response of power from a system or power from elements of the system to a change in locally sensed system frequency.
- (System) The sum of the change in demand, and the change in generation, divided by the change in frequency, expressed in megawatts per 0.1 Hertz (MW/0.1 Hz).

As noted above, Frequency Response is the characteristic of load and generation within Balancing Authorities and Interconnections. It reacts or responds with changes in power to attempted changes in load-resource balance that result in changes to system frequency. Because the loss of a large generator is much more likely than a sudden loss of an equivalent amount of load, Frequency Response is typically discussed in the context of a loss of a large generator. Included within Frequency Response are many components of that response. Understanding Frequency Response and the FRS requires an understanding of each of these components and how they relate to each other.


Frequency Response Illustration

The following simple example is presented to illustrate the components of Frequency Response in graphical form. It includes a series of seven graphs that illustrate the various components of Frequency Response and a brief discussion of each describing how these components react to attempted changes in the load-resource balance and resulting changes in system frequency. The illustration is based on an assumed Disturbance event of the sudden loss of 1000 MW of generation. Although a large event is used to illustrate the response components, even small frequently occurring events will result in similar reactions or responses. The magnitude of the event only affects the shape of the curves on the graph; it does not obviate the need for Frequency Response.

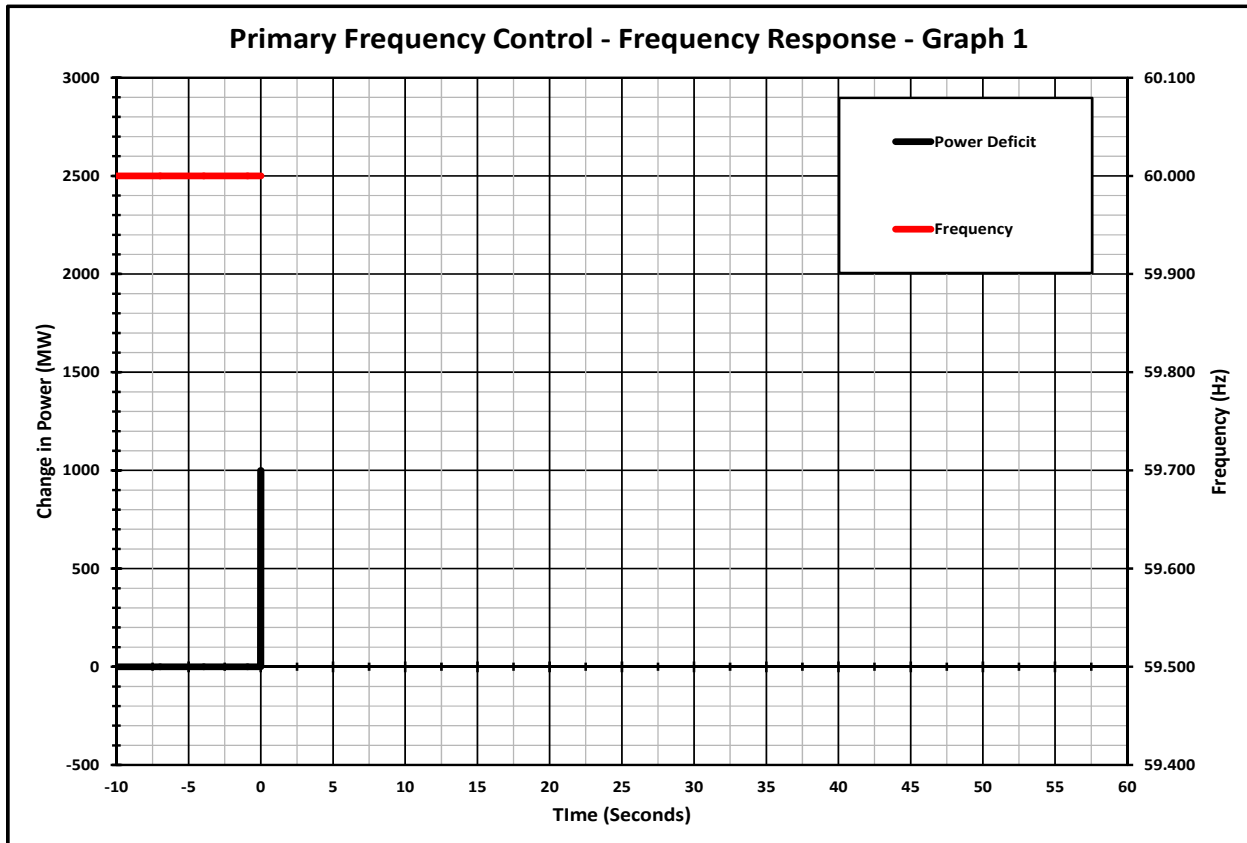

The first graph, Primary Frequency Control – Frequency Response – Graph 1, presents a sudden loss of generation of 1000 MW. The components are presented relative to time as shown on the horizontal Time axis in seconds. This simplified example assumes a Disturbance event of the sudden loss of generation resulting from a breaker trip that instantaneously removes 1000 MW of generation from the interconnection. This sudden loss is illustrated by the power deficit line shown in black using the MW scale on the left. Interconnection frequency is illustrated by the frequency line shown in red using the Hertz scale on the right. Since the Scheduled Frequency is normally 60 Hz, it is assumed that this is the frequency when the Disturbance event occurs.

Even though the generation has tripped and power injected by the generator has been removed from the interconnection, the loads continue to use the same amount of power. The “Law of Conservation of Energy”³ requires that the 1000 MW must be supplied to the interconnection if energy balance is to be “conserved.” This additional 1000 MW of power is produced by extracting kinetic energy that was stored in the rotating mass of all of the synchronized generators and motors on the interconnection – essentially using this equipment as a giant flywheel. The extracted energy supplies the “balancing inertia”⁴ power required to maintain the power and energy balance on the interconnection. This balancing inertia power is produced by the generators’ spinning inertial mass’ resistance to the slowdown in speed of the rotating equipment on the interconnection that both provides the stored kinetic energy and reduces the frequency of the interconnection. This is illustrated in the second graph, Primary Frequency Control – Frequency Response – Graph 2, by the orange dots representing the balancing inertia power that exactly overlay and offset the power deficit.

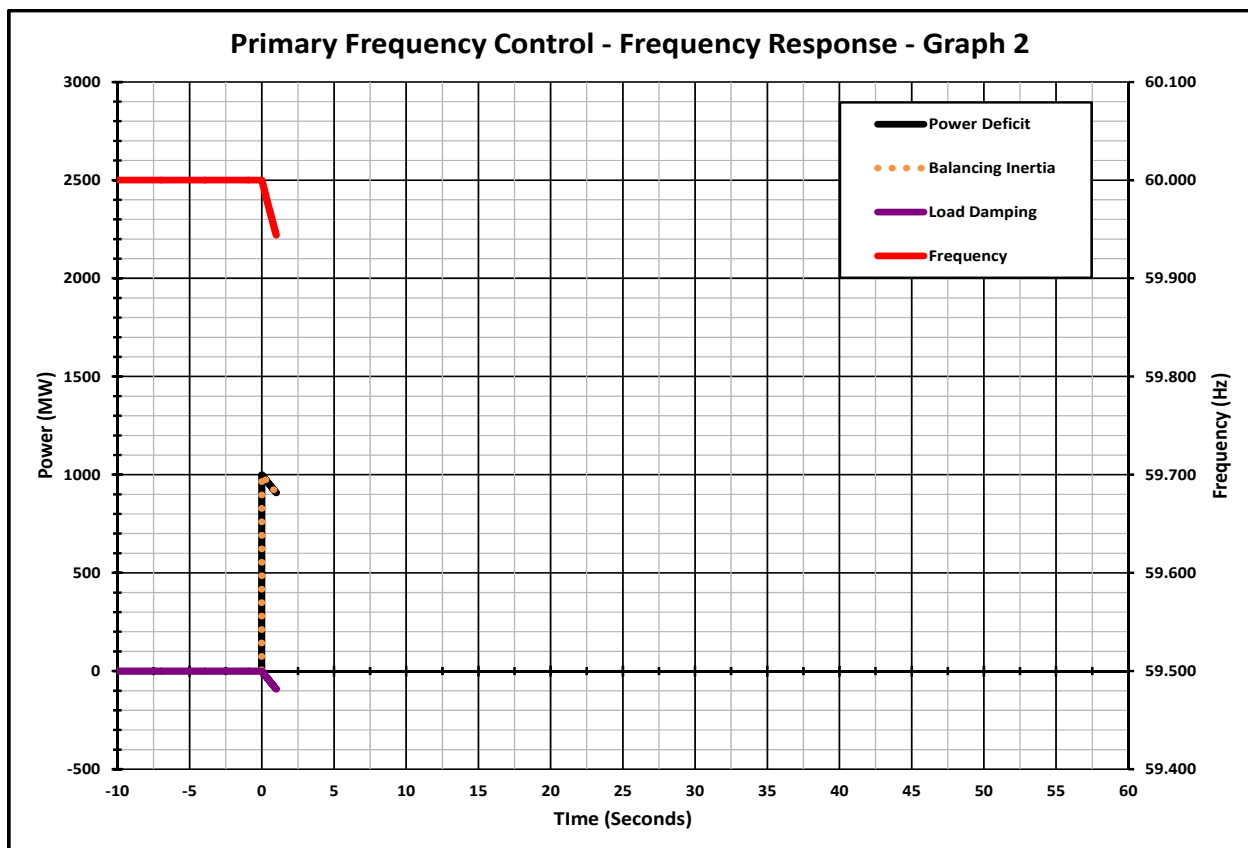

As the frequency decreases, synchronized motors slow, as does the work they are providing, resulting in a decrease in load called “load damping.” This load damping is the reason that the power deficit initially declines. Synchronously operated motors will contribute to load


³ The “Law of Conservation of Energy” is applied here in the form of power. If energy must be conserved, then power which is the first derivative of energy with respect to time, must also be conserved.

⁴ The term “balancing Inertia” is coined here from the terms “inertial frequency response” and “balancing energy”. Inertial frequency response is a common term used to describe the power supplied for this portion of the frequency response and balancing energy is a term used to describe the market energy supposedly purchased to restore energy balance.

damping. Variable speed drives that are decoupled from the interconnection frequency do not contribute to load damping. In general, any load that does not change with interconnection frequency including resistive load will not contribute to load damping or Frequency Response.

It is important to note that the power deficit equals exactly the balancing inertia, indicating that there is no power or energy imbalance at any time during this process. What is normally considered as “balancing power or energy” is actually power or energy required to correct the frequency error from scheduled frequency. Any apparent power or energy imbalance is corrected instantaneously by the balancing inertia power and energy extracted from the interconnection. Thus the balancing function is really a frequency control function described as a balancing function because ACE is calculated in MWs instead of Hertz, frequency error.


During the initial seconds of the Disturbance event, the governors have yet to respond to the frequency decline. This is illustrated with the Blue line on the third graph, Primary Frequency Control – Frequency Response – Graph 3, showing Governor Response. This time delay results from the time that it takes the controller to adjust the equipment and the time it takes the mass to flow from the source of the energy (main steam control valve for steam turbines, the combustor for gas turbines, or the gate valve for hydro turbines) to the turbine-generator blades where the power is converted to electrical energy.

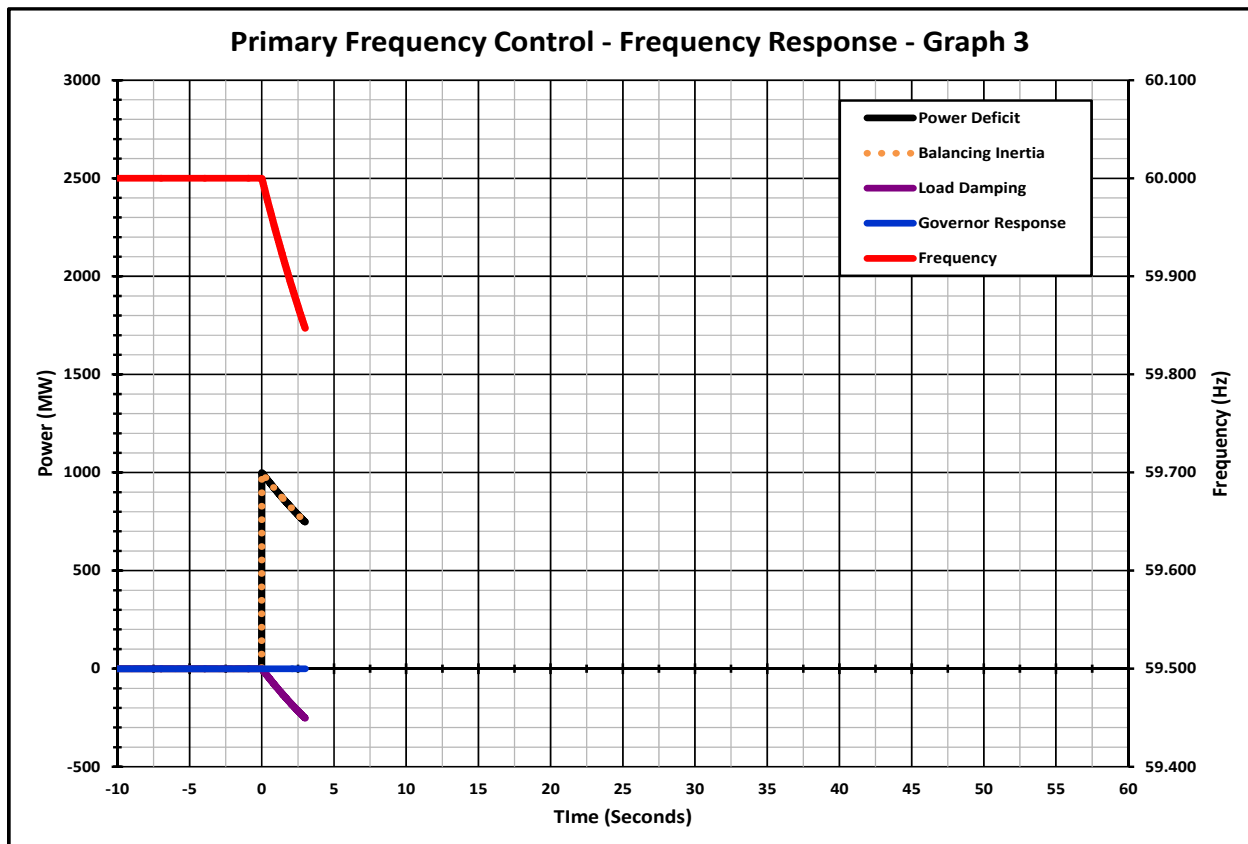

Note that the frequency continues to decline due to the ongoing extraction by balancing inertia power of energy from the rotating turbine-generators and synchronous motors on the

interconnection. The reduction in load also continues as the effect of load damping continues to reduce the load while frequency declines. During this time delay (before the governor response begins) the balancing inertia limits the rate of change of frequency.


After a short time delay, the governor response begins to increase rapidly in response to the initial rapid decline in frequency, as illustrated on the fourth graph, Primary Frequency Control – Frequency Response – Graph 4. Governor response exactly offsets the power deficit at the point in time that the frequency decline is arrested. At this point in time, the balancing inertia has provided its contribution to reliability and its power contribution is reduced to zero as it is replaced by the governor response. If the time delay associated with the delivery of governor response is reduced, the amount of balancing inertia required to limit the change in frequency by the Disturbance event can also be reduced. This supports the conclusion that balancing inertia is required to manage the time delays associated with the delivery of Frequency Response. Not only is the rapid delivery of Frequency Response important, but the shortening of the time delay associated with its delivery is also important. Therefore, two important components of Frequency Response are 1) how long the time delay is before the initial delivery of response begins; and 2) how much of the response is delivered before the frequency change is arrested.

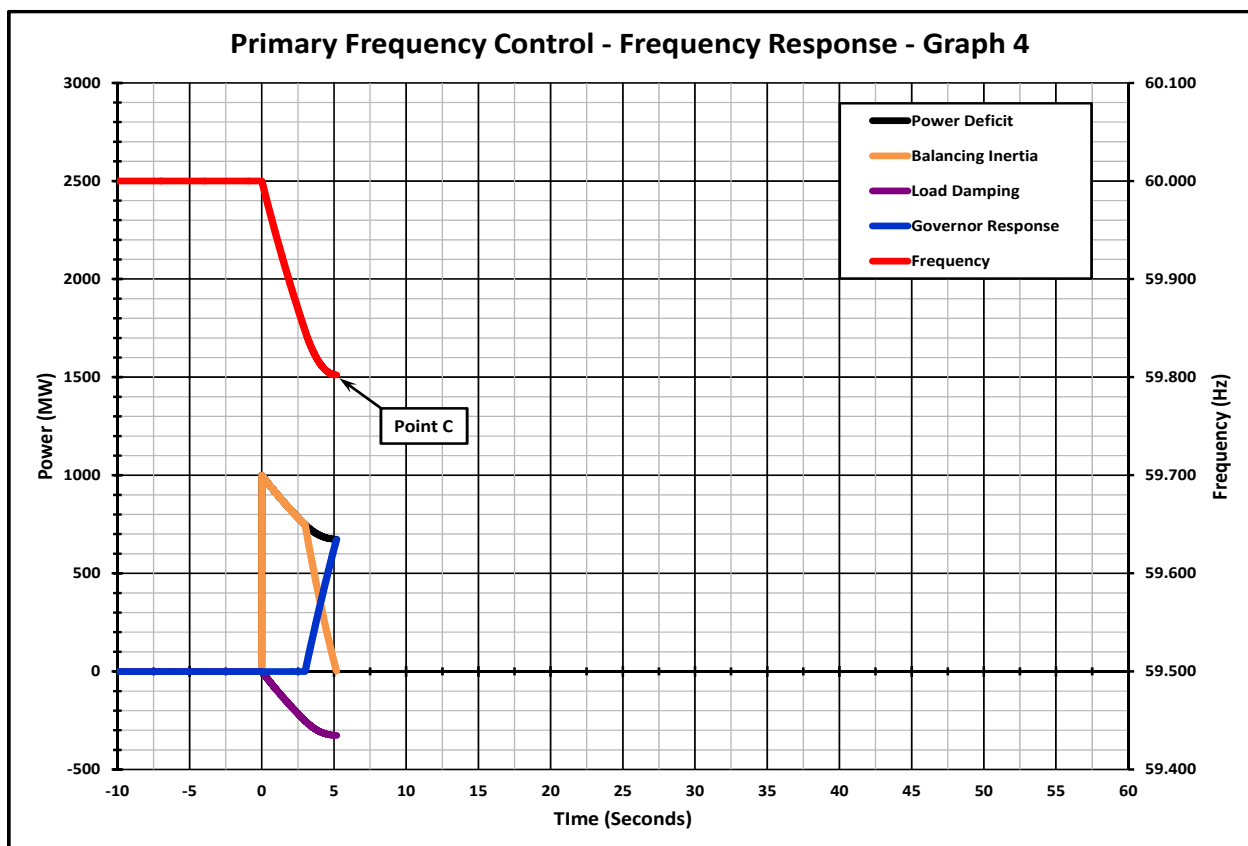

This point, at which the frequency is first arrested, is defined as “Point C” and Frequency Response calculated at this point is called the “**arrested frequency response.**” The arrested


frequency is normally the minimum (maximum for load loss events) frequency that will be experienced during a Disturbance event. From a reliability perspective, this minimum frequency is the frequency that is of concern. Adequate reliability requires that frequency at the time frequency is arrested remain above the under-frequency relay settings so as not to trip these relays and the firm load interrupted by them. Frequency Response delivered after frequency is arrested at this minimum level provides less reliability value than Frequency Response delivered before Point C, but greater value than Secondary Frequency Control power and energy which is delivered minutes later.

Once the frequency decline is arrested, the governors continue to respond because of the time delay associated with their Governor Response. This results in the frequency partially recovering from the minimum arrested value and results in an oscillating transient that follows the minimum frequency (arrested frequency) until power flows and frequency settle during the transient period that ends roughly 20 seconds after the Disturbance event. This post-disturbance transient period is included on the fifth illustrative graph, Primary Frequency Control – Frequency Response – Graph 5.

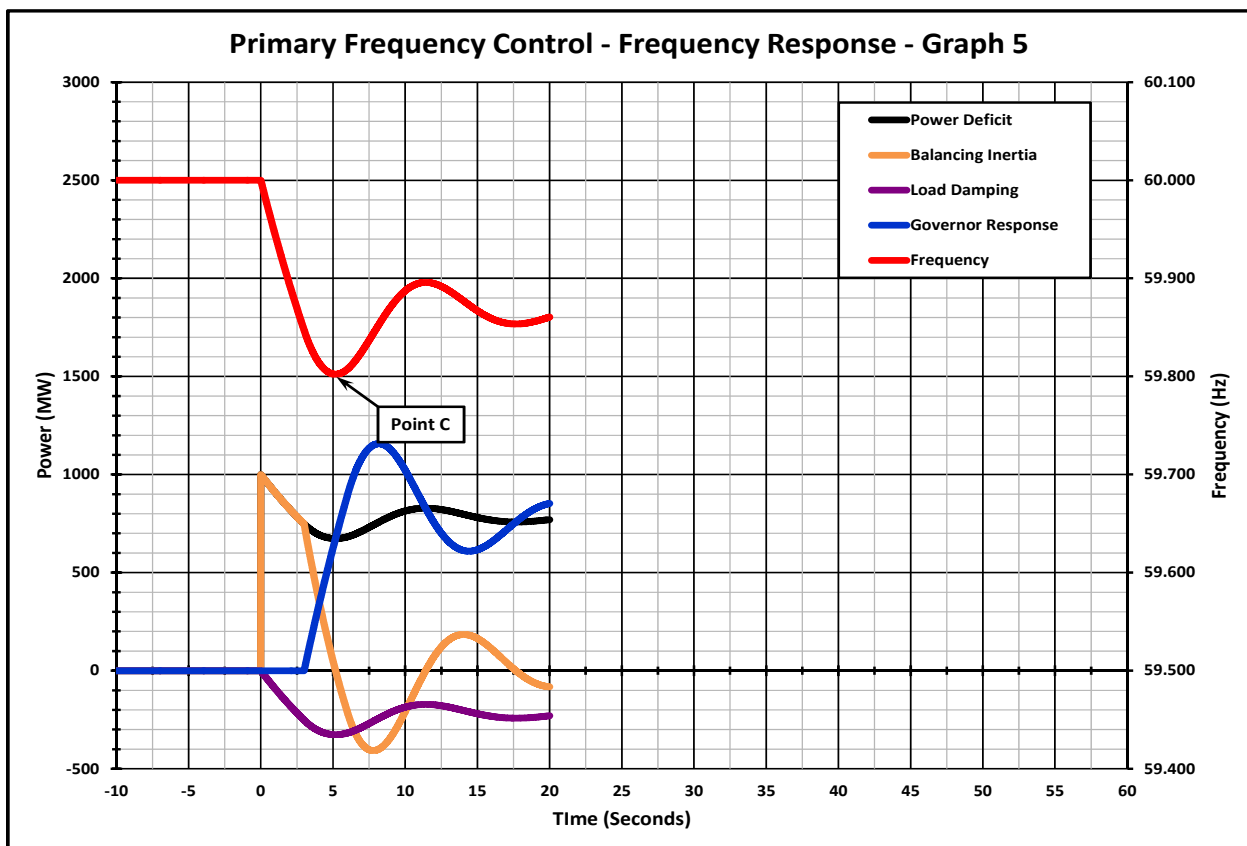


The total Disturbance event illustration is presented on the sixth graph, Primary Frequency Control – Frequency Response – Graph 6. Frequency and power contributions stabilize at the end of the transient period. Frequency Response calculated from data measured during this

settled period is called the “Settled Frequency Response.” The Settled Frequency Response is the best measure to use as an estimator for the “Frequency Bias Setting” discussed later.

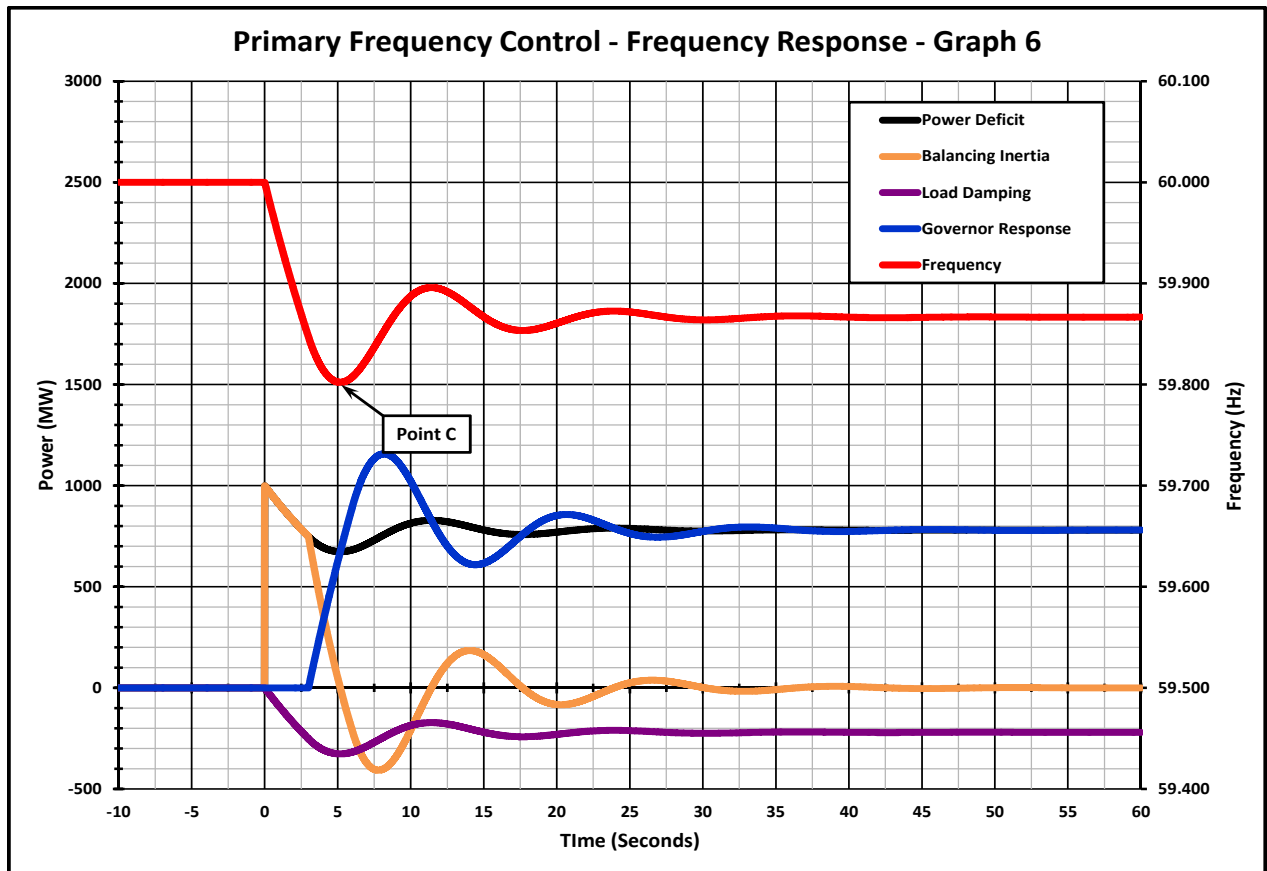

The final Disturbance event illustration is presented on the seventh graph, Primary Frequency Control – Frequency Response – Graph 7. This graph shows the averaging periods used to estimate the pre-disturbance A-Value averaging period and the post-disturbance B-Value averaging period used to calculate the settled frequency response. A discussion of the measurement of Frequency Response immediately follows these graphs. That discussion includes consideration of the factors that affect the methods chosen to measure Frequency Response for implementation in a reliability standard.

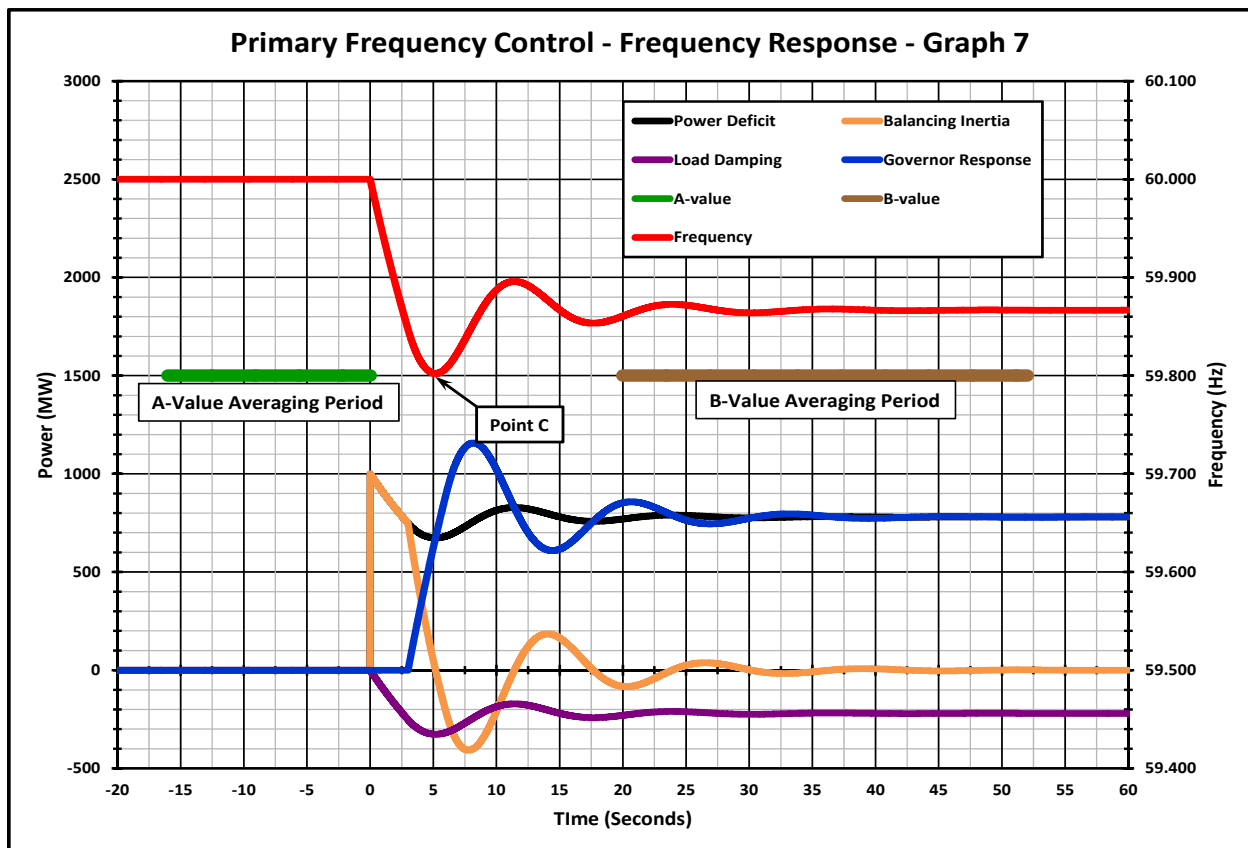

Frequency Response Measurement (FRM)

The classic Frequency Response points A, C, and B, shown below in Fig. 1 Frequency Response Characteristic, are used for measurement as found in the Frequency Response Characteristic Survey Training Document within the NERC operating manual, found at http://www.nerc.com/files/opman_7-1-11.pdf. This traditional Frequency Response Measure has recently been more specifically termed “**settled frequency response**.” This term has been used because it provides the best Frequency Response Measure to estimate the Frequency Bias Setting in Tie-line Bias Control based Automatic Generation Control Systems. However, the industry has recognized that there is considerable variability in measurement resulting from the selection of Point A and Point B in the traditional measure making the traditional measurement method unsuitable as the basis for an enforceable reliability standard in a real world setting of multiple Balancing Authority interconnections.

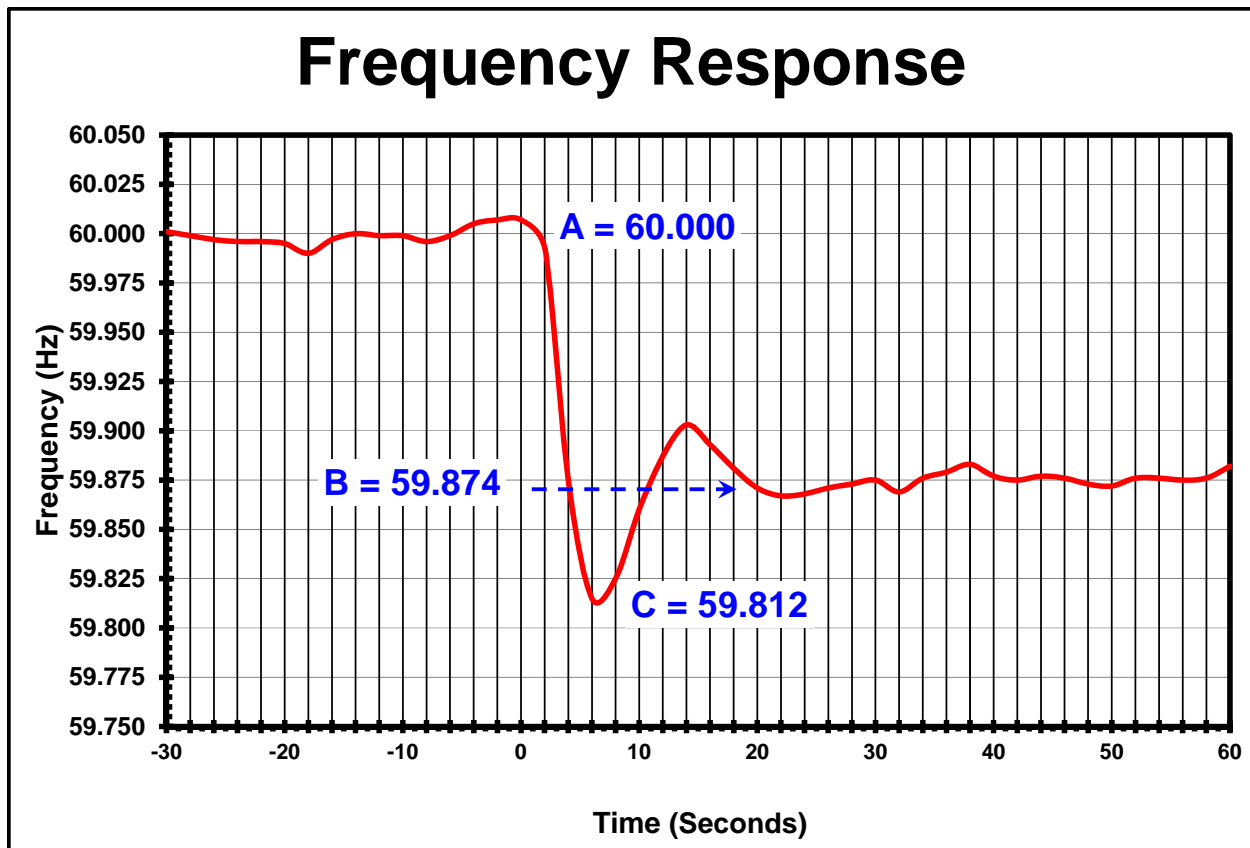


Figure 1. Frequency Response Characteristic

By contrast, measuring an Interconnection’s settled frequency response is straightforward and fairly accurate. All that’s needed to make the calculation is to know the size of a given contingency (MW), divide this value by the change in frequency and multiply the results by 10 since frequency response is expressed in MW/0.1Hz.

Measuring a BA’s frequency response is more challenging. Prior to BAL-003-1, NERC’s *Frequency Response Characteristic Survey Training Document* provided guidance to calculate Frequency Response. In short, it told the reader to identify the BA’s interchange values “immediately before” and “immediately after” the Disturbance event and use the difference to calculate the MWs the BA deployed for the event. There are two challenges with this approach:

- Two people looking at the same data would come up with different values when assessing which exact points were immediately before and after the event.
- In practice, the actual response provided by the BA can change significantly in the window of time between point B and when secondary and tertiary control can assist in recovery.

Therefore, the measurement of settled frequency response has been standardized in a number of ways to limit the variability in measurement resulting from the poorly specified selection of Point A and Point B. It should be noted that t-0 has been defined as the first scan value that

shows a deviation in frequency of some significance, usually approaching about 10 mHz. The goal is such that the first scan prior to t-0 was unaffected by the deviation and appropriate for one of the averaging points.

- The A-value averaging period of approximately the previous 16 seconds prior to t-0 was selected to allow for an averaging of at least 2 scans for entities utilizing 6 second scan rates. (All time average period references in this document are for 2 second scan rates unless noted otherwise.)
- The B-value averaging period of approximately (t+20 to t+52 seconds) was selected to attempt to obtain the average of the data after primary frequency response was deployed and the transient completed(settled), but before significance influence of secondary control. Multiple periods were considered for averaging the B-value:
 - 12 to 24 sec
 - 18 to 30 sec
 - 20 to 40 sec
 - 18 to 52 sec
 - 20 to 52 sec

It is necessary for all BAs from an interconnection to use the same averaging periods to provide consistent results. In addition, the SDT decided that until more experience is gained, it is also desirable for all interconnections to use the same averaging periods to allow comparison between interconnections.

The methods presented in this document only address the values required to calculate the frequency response associated with the frequency change between the initial frequency, A-Value, and the settling frequency, B-Value. No reasonable or consistent calculations can be made relating to the arresting frequency, C-Value, using Energy Management System (EMS) scan rate data as long as 6-seconds or tie-line flow values associated with the minimum value of the frequency response characteristic (C-value) as measured at the BA level.

Both the calculation of the frequency at Point A and the frequency at Point B began with the assumption that a 6-second scan rate was the source of the data. Once the averaging periods for a 6-second scan rate were selected, the averaging periods for the other scan rates were selected to provide as much consistency as possible between BAs with different scan rates.

The Frequency at Point A was initially defined as the average of the two scans immediately prior to the frequency event. All other averaging periods were selected to be as consistent as possible with this 12 second average scan from the 6-second scan rate method. In addition, the **“actual net interchange immediately before Disturbance”** is defined as the average of the same scans as used for the Point A frequency average.

The Frequency at Point B was then selected to be an average as long as the average of 6-second scan data as possible that would not begin until most of the hydro governor response had been delivered and would end before significant Automatic Generation Control (AGC) recovery response had been initiated as indicated by a consistent frequency restoration slope. The **“actual net interchange immediately after Disturbance”** is defined as the average of the same scans as used for the Point B frequency average.

B Averaging Period Selection:

Experience from the Electric Reliability Council of Texas (“ERCOT”) and the field trail on other interconnections indicated that the 12 to 24 second and 18 to 30 second averaging periods were not suitable because they did not provide the consistency in results that the other averaging periods provided, and that the remaining measuring periods do not provide significantly different results from each other. The team believed that this was observed because the transients were not complete in all of the samples using these averaging periods.

The 18 to 52 second and 20 to 52 second averaging periods were compared to each other, with the 20 to 52 second period providing more consistent values, believed to result from the incomplete transient in some of the 18 to 52 second samples.

This left a choice between the 20 to 40 second and the 20 to 52 second averaging periods. The team recognized that there would be more AGC response in the 20 to 52 second period, but the team also recognized that the 20 to 52 second period would provide a better measure of squelched response from outer loop control action. The 20 to 52 second period was selected because it would indicate squelched response from outer-loop control and provide incentive to reduce response withdrawal. The final selections for the data averaging periods used in FRS Form 1 are shown in the table below.

Definitions of Frequency Values for Frequency Response Calculation			
Scan Rate	T 0 Scan	A Value (average)	B Value (average)
6-Seconds	Identify first significant change in frequency as the T 0 scan	Average of T-1 through T-2 scans	Average of T+4 through T+8 scans
5-Seconds		Average of T-1 through T-2 scans	Average of T+5 through T+10 scans
4-Seconds		Average of T-1 through T-3 scans	Average of T+6 through T+12 scans
3-Seconds		Average of T-1 through T-5 scans	Average of T+7 through T+17 scans
2-Seconds		Average of T-1 through T-8 scans	Average of T+10 through T+26 scans

Consistent measurement of Primary Frequency Response is achievable for a selected number of events and can produce representative frequency response values, provided an appropriate sample size is used in the analysis. Available research investigating the minimum sample size to provide consistent measurements of Frequency Response has shown that a minimum sample size of 20 events should be adequate.

Measurement of Primary Frequency Response on an individual resource or load basis requires analysis of energy amounts that are often small and difficult to measure using current methods. In addition, the number of an interconnection's resources and loads providing their response could be problematic when compiling results for multiple events.

Measurement of Primary Frequency Response on an interconnection (System) basis is straight forward provided that an accurate frequency metering source is available and the magnitude of the resource/load imbalance is known in MWs.

Measurement on a Balancing Authority basis can be a challenge, since the determination of change in MWs is determined by the change in the individual BA's metered tie lines. Summation of tie lines is accomplished by summing the results of values obtained by the digital scanning of meters at intervals up to six seconds, resulting in a non-coincidental summing of values. Until the technology to GPS time stamp tie line values at the meter and the summing of those values for coincidental times is in use throughout the industry, it is necessary to use averaging of values described above to obtain consistent results.

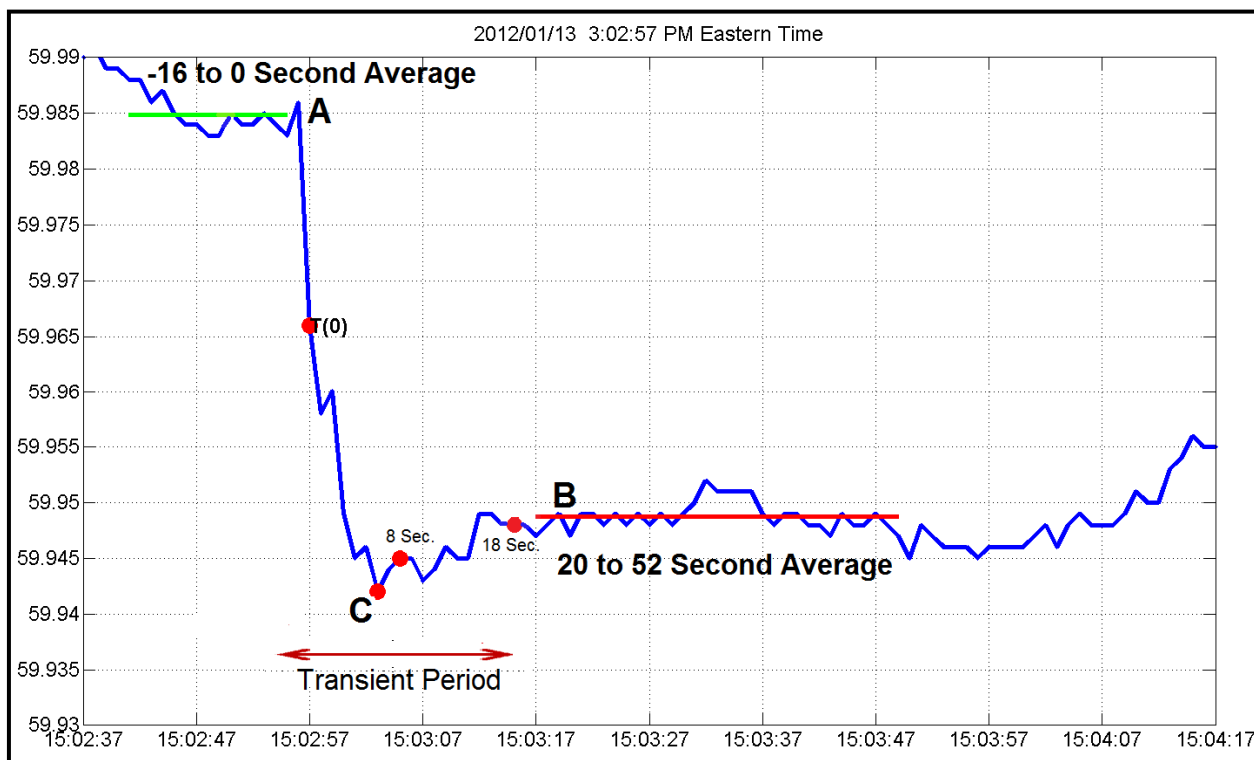


Figure 2. Frequency Response Measurement

The standardized measure is shown graphically in Fig. 2 Frequency Response Measurement with the averaging periods shown by the solid green and red lines on the graph. Since FERC directed a performance obligation for BAL-003-1, it is important to be more objective in the measurement process. The standardized calculation is available on FRS Form 2 for EMS scan rates of 2, 3, 4, 5, and 6 seconds at http://www.nerc.com/filez/standards/Frequency_Response.html.

Arrested Frequency Response

There is another measure of Frequency Response that is of interest when developing a Frequency Response estimate that not only will be used for estimating the Frequency Bias Setting, but will also be used to assure reliability by operating in a manner that will bound interconnection frequency and prevent the operation of Under-frequency Relays. This Frequency Response Measure has recently been named “**arrested frequency response.**” This Frequency Response is significantly affected by the inertial Frequency Response, the governor Frequency Response and the time delays associated with the delivery of governor Frequency

Response. It is calculated by using the change in frequency between the initial frequency, A, and the maximum frequency change during the event, C, instead of using the change between A and B. Arrested Frequency Response is the correct response for determining the minimum Frequency Response related to under-frequency relay operation and the support of interconnection reliability. This is because it can be used to provide a direct estimate of the maximum frequency deviation an interconnection will experience for an initial frequency and a given size event in MW. Unfortunately, arrested frequency response cannot currently be measured using the existing EMS-based measurement infrastructure. This limitation exists because the scan rates currently used in industry EMSs are incapable of measuring the net actual interchange at the same instant that the maximum frequency deviation is reached. Fortunately, the ratio of arrested frequency response and settled frequency response tends to be stable on an interconnection. This allows the settled frequency response value to be used as a surrogate for the arrested frequency response and implement a reasonable measure upon which to base a standard. One consequence of using the settled frequency response as a surrogate for the arrested frequency response is the inclusion of a large reliability margin in Interconnection Frequency Response Obligation to allow for the difference between the settled frequency response as measured and the arrested frequency response that indicates reliability.

As measurement infrastructure improves one might expect the Frequency Response Obligation to transition to a measurement based directly on the arrested frequency response while the Frequency Bias Setting will continue to be based on the settled frequency response. However, at this time, the measurement devices and methods in use do not support the necessary level of accuracy to estimate arrested frequency response contribution for an individual Balancing Authority.

Frequency Response Definition and Examples

Limitations of the measurement infrastructure determine the measurement methods recommended in this standard. The measurement limitations provide opportunities to improve the Frequency Response as measured in the standard without contributing to an improvement in Frequency Response that contributes to reliability. These definitions and examples provide a basis for determining which contributions to Frequency Response contribute the most to improved reliability. They also provide the basis for determining on a case by case basis whether the individual contributors to the Frequency Response Measure are also contributing to reliability.

General Frequency Response Characteristics

In the simplest case Frequency Response includes any automatic response to changes in local frequency. If that response works to decrease that change in frequency, it is beneficial to reliability. If that response works to increase that change in frequency, it is detrimental to reliability. However, this definition does not address the relative value of one response as compared to other responses that may be provided in a specific case.

There are numerous characteristics associated with the Frequency Response that affect the reliability value and economic value of the response. These characteristics include:

1. **Inertial** – the response is inertial or approximates inertial response

Inertial response provides power without delay that is proportional to the frequency and the change in frequency. Therefore, power provided by electronic control as synthetic Inertial response must be proportional to the frequency and change in frequency and be provided without a time delay.

2. **Immediate** – no unnecessary intentional time delays or reduction in the rate of response delivery
 - a. time delay before the beginning of the response
Turbines that convert heat or kinetic energy have time delays related to the time delay from the time that the control valves are moved to initiate the change in power and the time that the power is delivered to the generator. These times are usually associated with the time it takes a change in mass flow to travel from the control valve to the first blades of the turbine in the turbine generator.
 - b. reduction in the rate of response delivery
There are natural delays associated with the rate of response delivery that are related to the mass flow travel from the first turbine blades to the last turbine blades. In addition, some turbines have intentional delays designed into the control system to slow the rate of change in the delivery of the kinetic energy or fuel to the turbine to prevent the turbine or other equipment from being damaged, hydro turbines, or to prevent the turbine from tripping due to excessive rate of change, gas turbines.
3. **Proportional** – the amount of the total response is proportional to the frequency error
 - a. No Deadband – the response is proportional across the entire frequency range
 - b. Deadband – the response is only proportional outside of a defined deadband
4. **Bi-directional** – the response occurs to both increases and decreases in frequency
5. **Continuous** – there are no discontinuities in the delivery of the response (no step changes)
6. **Sustained** – the response is sustained until frequency is returned to schedule

Frequency Response Reliability Value

This section contains a more detailed discussion of the various characteristics of Frequency Response listed in the previous section. It also provides an indication of the relative value of these characteristics with respect to their contribution to reliability. Finally, it includes some examples of the described responses.

Inertial Response is provided from the stored energy in the rotating mass of the turbine-generators and synchronous motors on the interconnection. It limits the rate of change of frequency until sufficient Frequency Response can be supplied to arrest the change in frequency. Its reliability value increases as the time delay associated with the delivery of other Frequency Response on the interconnection increases. If those time delays are minimal, then the value of inertial response is low. If all time delays associated with the Frequency Response could be eliminated, then inertial response would have little value.

The reliability value of Inertial Response is the greatest on small interconnections because the size of the Disturbance events is larger relative to the inertia of the interconnection. Electronic controls have been developed to provide synthetic inertial response from the stored energy in asynchronous generators to supplement the natural inertial response. Some Type III & IV Wind Turbines have this capability. In addition, electronically controlled SCRs have been developed that can store energy in the electrical system and release this stored energy to supply synthetic inertial response when required.

Immediate Response is provided by load damping and because the time delays associated with its delivery are very short (related to the speed of electrical signal in the electrical system); load damping requires very little inertial response to limit arrested frequency effectively. Synthetic immediate response can also be supplied from loads because in many cases, there is no mass flow time delay associated with the load process providing the power and energy reduction. Therefore, loads can provide an immediate response with a higher reliability value than generators with time delays required by the physics of the turbine-generator.

Governor response has time delays associated with its delivery. Governor response provided with shorter time delays has a higher reliability value because those shorter time delays require less inertial response to arrest frequency. Governor response is provided by the turbine-generators on the interconnection. Time delays associated with governor response vary depending on the type of turbine-generator providing the response.

The longest time delays are usually associated with high head hydro turbine-generators that require long times from the governor action until the additional mass flow through the turbine. These units may also have the longest delivery time associated with the full delivery of response because of the timing designed into the governor response.⁵

Intermediate time delays are usually associated with steam turbine-generators. The response begins when the steam control valves are adjusted and the steam mass flows from the valves to the first high pressure turbine blades. The delivery times associated with the full delivery of response may require the steam to flow through high, intermediate and low pressure turbines including reheat flows before full power is delivered. These times are shorter than those of the hydro turbine-generators in general, but not as fast as the times associated with gas turbines.⁶

Gas turbines typically have the shortest time delays, because control is provided by injecting more or less fuel into the turbine combustor and adjusting the air control dampers. These control changes can be initiated rapidly and the mass flow has the shortest path to the turbine

⁵ Interconnected Power System Response to Generation Governing: Present Practice and Outstanding Concerns – Final Report, IEEE, May 2007, pp. 1-6 – 1-9.

⁶ Interconnected Power System Response to Generation Governing: Present Practice and Outstanding Concerns – Final Report, IEEE, May 2007, pp. 1-4 – 1-6.

blades. There may be timing limitations related to the rate of change in output of the gas turbine-generator to maintain flame stability in some cases slowing the rate of change.⁷

Synthetic Governor Response can be supplied by certain loads and storage systems. The immediacy of the response is normally limited only by the electronic controls used to activate the desired response. Synthetic response, when it can be supplied immediately without significant time delay, has a higher reliability value because it requires less inertial response to achieve smaller arrested frequency deviations.

Proportional Response indicates that the response provided is proportional in magnitude to the frequency error. Response deadbands cause a non-proportional response and reduce the value of the response with respect to reliability. Contrary to general consensus, deadbands do not reduce the amount of Frequency Response that must be provided, they only transfer the responsibility for providing that Frequency Response from one source on the interconnection to another. For a given response, the response with the smaller deadband has the greater reliability value. Therefore, deadbands should be set to the smallest value that supports overall reliable operation including the reliable operation of the generator.

Electronic controls have also been developed to provide synthetic governor response. When these controls are applied to certain loads or stored energy systems, they can be programmed to provide synthetic governor response similar to the proportional response of a turbine-generator governor. Governor response in generators is limited to a small percentage of the output of the generating unit, while synthetic governor response could be applied to much larger percentages of loads or storage devices providing such response.

Load damping provides a proportional response.

Continuous Response is response that has no discontinuous (step) changes in the frequency versus response curve. Step changes (Non-continuous Response) in the Governor Response curve can lead to frequency instabilities at frequencies near the changes. The ERCOT Interconnection observed this and has since prohibited the use of governor response characteristics incorporating step responses.

Step responses also occur with the implementation of load interruption using under-frequency or over-frequency relays.

Bi-directional Response is response that occurs in both directions, when the frequency is increasing and when the frequency is decreasing. A uni-directional response is a response that only occurs once when frequency is decreasing or when frequency is increasing.

Inertial response, governor response and load damping are all bi-directional responses. Certain loads are capable of providing proportional bi-directional response while others are only capable of providing non-proportional bi-directional response.

⁷ Interconnected Power System Response to Generation Governing: Present Practice and Outstanding Concerns – Final Report, IEEE, May 2007, pp. 1-16 – 1-19.

The ERCOT Load Resource program is a uni-directional response program. Loads are only tripped when frequency declines below a given set-point. When frequency is restored above that set-point, the loads must be manually reconnected. As a consequence, the Frequency Response only occurs once with declining frequency and does not oppose the increase in frequency after the initial decline. If there should be a frequency oscillation, the uni-directional response will not contribute to the opposition of a second frequency decline across the set-point during an oscillation event. Once a uni-directional response has occurred, it is unavailable for a second decline before reset.

Step or proportional responses implemented bi-directionally can lead to frequency instability when there is less continuous frequency response than the magnitude of the change in continuous response between the trip and reset frequencies in step, or the proportional response rate of change is greater than the underlying continuous response. A step bi-directional response will have the load reconnected as frequency recovers from the event thus opposing the increase in frequency during recovery, and also resetting the load response for the next frequency decline automatically. Bi-directional response obviously has a greater reliability value than uni-directional response.

Sustained Response is provided at its full value until frequency is restored to its scheduled value. On today's interconnections, few frequency responses are fully sustained until frequency has been restored to its scheduled value. On steam based turbine-generators, the steam pressure may drop after a time as the result of the additional steam flow from governor action. However, in general this has not been a problem because most responses are incomplete at the time that frequency has been initially arrested and the additional response has generally been sufficient to make up for more than these unpreventable reductions in response. However, the intentional withdrawal of response before frequency has been restored to schedule can cause a decline in frequency beyond that which would be otherwise expected. This intentional withdrawal of response is highly detrimental to reliability. Therefore, it can be concluded in general that sustained response has a higher reliability value than un-sustained response.

On an interconnection, the withdrawal of response due to the loss of steam pressure on the steam units may be offset by the slower response of hydro turbine-generators. In these cases, the reliability of the combined response provides a greater reliability value than the individual response of each type. The steam turbine-generators provide a fast response that may be reduced, while the hydro turbine-generators provide a slower response, contributing less to the arresting response, offsetting any reduction by the steam turbine-generators to assure a sustained response.

Sustained Response must also be considered for any resource that has a limited duration associated with its response. The amount of stored energy available from a resource may limit its ability to sustain response for a duration of time necessary to support reliability.

Frequency Response Cost Factors

In every system of exchange there are two sides; the supply side and the demand side. The supply side provides the services used by the demand side. In the case of Frequency Response,

the supply side includes all providers of Frequency Response and the demand side includes all participants that create the need for Frequency Response.

Frequency Response Costs – Supply Side

There are a number of factors that affect the cost of providing Frequency Response from resources. Since there is a cost associated with those factors, some method of appropriate compensation could be made available to those resources providing Frequency Response. Without compensation, providers of Frequency Response will be put in the position of incurring additional cost that can be avoided only by reducing or eliminating the response they provide. These costs are incurred independently of whether provided for in a formal Regional Transmission Organization/Independent System Operator (RTO/ISO) market or in a traditional BA subject to the FERC pro-forma tariffs.

It is the responsibility of the BA or the RTO/ISO to acquire the necessary amount of Frequency Response to support reliability in the most cost effective manner. This function is performed best when the suppliers are evaluated based on the value of the Frequency Response they provide and compensated appropriately for that Frequency Response. Suppliers provide Frequency Response when they are assured that they will receive fair compensation. Before considering how to perform this evaluation and compensation, the costs associated with providing Frequency Response should be understood and evaluated with respect to the level of reliability they offer.

Some cost factors that have been identified for providing Frequency Response include:

1. **Capacity Opportunity Cost** – the costs, including opportunity costs, associated with reserving capacity to provide Frequency Response. These costs are usually associated with the alternative use of the same capacity to provide energy or other ancillary services. There may also be capacity opportunity costs associated with the loss in average capacity by a load providing Frequency Response.
2. **Fuel Cost** – The cost of fuel used to provide the Frequency Response. The costs for fuel to provide Frequency Response can result in energy costs significantly different from the system marginal energy cost, both higher and lower. This is the case when Frequency Response is provided by resources that are not at the system marginal cost.
3. **Energy Efficiency Penalty Costs** – the costs associated with the loss in efficiency when the resource is operated in a mode that supports the delivery of Frequency Response. This cost is usually in the form of additional fuel use to provide the same amount of energy. An example is the difference between operating a steam turbine in valve control mode with an active governor and sliding pressure mode with valves wide open and no active governor control except for over-speed. This cost is incurred for all of the energy provided by the resource, not just the energy provided for Frequency Response. There may be additional energy costs associated with a load providing Frequency Response from loss in efficiency of their process when load is reduced.
4. **Capacity Efficiency Penalty Costs** – the costs associated with any reduction in capacity resulting from the loss of capacity associated with the loss in energy efficiency. When efficiency is lost, capacity may be lost at the same time because of limitations in the amount of input energy that can be provided to the resource.

5. **Maintenance Costs** – the operation of the resource in a manner necessary to provide Frequency Response may result in increases in the maintenance costs associated with the resource.
6. **Emissions Costs** – the additional costs incurred to manage any additional emissions that result when the resource is providing Frequency Response or stands ready to provide Frequency Response.

A good contract for the acquisition of Frequency Response from a resource will provide appropriate compensation to the resource for all of the costs the resource incurs to provide Frequency Response. It will also provide a method to evaluate the least cost mix of resources necessary to provide the minimum required Frequency Response for maintaining reliability. Finally, it will provide the least complex method of evaluation considering the complexity and efficiency of the acquisition process.

Frequency Response Costs – Demand Side

Not only are there costs associated with acquiring Frequency Response from the supplying resources, there are costs associated with the amount of Frequency Response that must be acquired and influenced by those participants that create the need for Frequency Response. If the costs of acquiring Frequency Response from the supply resources can be assigned to those parties that create the need for Frequency Response, there is the promise that the amount of Frequency Response required to maintain reliability can be minimized. The considerations are the same as those that are driving the development of “real time pricing” and “dynamic pricing”. If the costs are passed on to those contributing to the need for Frequency Response, incentives are created to reduce the need for Frequency Response making interconnection operations less expensive and more reliable. The problem is to balance both cost and complexity against reliability on both the supply side and the demand side.

Rationale by Requirement

Requirement 1

R1. Each Frequency Response Sharing Group (FRSG) or Balancing Authority that is not a member of a FRSG shall achieve an annual Frequency Response Measure (FRM) (as calculated and reported in accordance with Attachment A) that is equal to or more negative than its Frequency Response Obligation (FRO) to ensure that sufficient Frequency Response is provided by each FRSG or Balancing Authority that is not a member of a FRSG to maintain Interconnection Frequency Response equal to or more negative than the Interconnection Frequency Response Obligation.

Background and Rationale

R1 is intended to meet the following primary objectives:

- Determine whether a Balancing Authority (BA) has sufficient Frequency Response for reliable operations.
- Provide the feeder information needed to calculate CPS limits and Frequency Bias Settings.

Primary Objective

With regard to the first objective, FRS Form 1 and the process in Attachment A provide the method for determining the Interconnections' necessary amount of Frequency Response and allocating it to the Balancing Authorities. The field trial for BAL-003-1 is testing an allocation methodology based on the amount of load and generation in the BA. This is to accommodate the wide spectrum of BAs from generation-only all the way to load-only.

Frequency Response Sharing Groups (FRSGs)

This standard proposes an entity called FRSG, which is defined as:

A group whose members consist of two or more Balancing Authorities that collectively maintain, allocate, and supply operating resources required to jointly meet the sum of the Frequency Response Obligations of its members.

This standard allows Balancing Authorities to cooperatively form FRSGs as a means to jointly meet the FRS. There is no obligation to form or be a part of FRSGs. The members of the FRSG would determine how to allocate sanctions among its members. This standard does not mandate the formation of FRSGs, but allows them as a means to meet one of FERC's Order No. 693 directives.

FRSG performance may be calculated one of two ways:

- Calculate a group NI_A and measure the group response to all events in the reporting year on a single FRS Form 1, or
- Jointly submit the individual BAs' Form 1s, with a summary spreadsheet that sums each participant's individual event performance.

Frequency Response Obligation and Calculation

The basic Frequency Response Obligation is based on annual load and generation data reported in FERC Form 714 (where applicable, see below for non-jurisdictional entities) for the previous full calendar year. The basic allocation formula used by NERC is:

$$FRO_{BA} = FRO_{Int} \times \frac{\text{Annual Gen}_{BA} + \text{Annual Load}_{BA}}{\text{Annual Gen}_{Int} + \text{Annual Load}_{Int}}$$

Where:

- Annual Gen_{BA} is the annual “Net Generation (MWh)”, FERC Form 714, line 13, column c of Part II - Schedule 3.
- Annual Load_{BA} is the annual “Net Energy for Load (MWh)”, FERC Form 714, line 13, column e of Part II - Schedule 3.
- Annual Gen_{Int} is the sum of all Annual Gen_{BA} values reported in that interconnection.
- Annual Load_{Int} is the sum of all Annual Load_{BA} values reported in that interconnection.

Balancing Authorities that are not FERC jurisdictional should use the [Form 714 Instructions](#) to assemble and submit equivalent data. Until the BAL-003-1 process outlined in Attachment 1 is implemented, Balancing Authorities can approximate their FRO by multiplying their Interconnection’s FRO by their share of Interconnection Bias. The data used for this calculation should be for the most recently filed Form 714. As an example, a report to NERC in January 2013 would use the Form 714 data filed in 2012, which utilized data from 2011.

Balancing Authorities that merge or that transfer load or generation need to notify the ERO of the change in footprint and corresponding changes in allocation such that the net obligation for the Interconnection remains the same and so that CPS limits can be adjusted.

Attachment A proposes the following Interconnection event criteria as a basis to determine an Interconnection’s Frequency Response Obligation:

- Largest category C loss-of-resource (N-2) event.
- Largest total generating plant with common voltage switchyard.
- Largest loss of generation in the interconnection in the last 10 years.

With regard to the second objective above (determining Frequency Bias Settings and CPS limits), Balancing Authorities have been asked to perform annual reviews of their Frequency Bias Settings by measuring their Frequency Response, dating back to Policy 1. This obligation was carried forward into BAL-003-01.b. While the associated training document provided useful information, it left many of the details to the judgment of the person doing the analysis. The FRS Form 1 and FRS Form 2 provide a consistent, objective process for calculating Frequency Response to develop an annual measure, the FRM.

The FRM will be computed from Single Event Frequency Response Data (SEFRD), defined as: “the data from an individual event from a Balancing Authority that is used to calculate its Frequency Response, expressed in MW/0.1Hz”. The SEFRD for a typical Balancing Authority in an Interconnection with more than one Balancing Authority is basically the change of its net actual interchange on its tie lines with its adjacent Balancing Authorities divided by the change in interconnection frequency. (Some Balancing Authorities may choose to apply corrections to their net actual interchange values to account for factors such as nonconforming loads. FRS Form 1 shows the types of adjustments that are allowed.)

A standardized sampling interval of approximately 20 to 52 seconds will be used in the computation of SEFRD values. Microsoft Excel® spreadsheet interfaces for EMS scan rates of 2 through 6 seconds are provided to support the computation.

Single Event Frequency Response Data⁸

The use of a “single event measure” was considered early in the development of the FRS for compliance because a single event measure could be enforced for each event on the interconnection making compliance enforcement a simpler process. The variability of the measurement of Frequency Response for an individual BA for an individual Disturbance event was evaluated to determine its suitability for use as a compliance measure. The individual Disturbance events were normalized and plotted for each BA on the Eastern and Western Interconnections. This data was plotted with a dot representing each event. Events with a measured Frequency Response above the FRO were shown as blue dots and events with a measured Frequency Response below the FRO were shown as red dots. In order to show the full variability of the results the plots have been provided with two scales, a large scale to show all of the events and small scale to show the events closer to the FRO or a value of 1.0. This data is presented on four charts titled Frequency Response Events as Normalized by FRO.


Analysis of this data indicates a single event based compliance measure is unsuitable for compliance evaluation when the data has the large degree of variability shown in these charts. Based on the field trial data provided, only 3 out of 19 BAs on the Western Interconnection would be compliant for all events with a standard based on a single event measure. Only 1 out of 31 BAs on the Eastern Interconnection would be compliant for all events with a standard based on a single event measure. The general consensus of the industry is that there is not a reliability issue with insufficient Frequency Response on any of the North American Interconnections at this time. Therefore, it is unreasonable to even consider a standard that would indicate over 90% of the BAs in North American to be non-compliant with respect to maintaining sufficient Frequency Response to maintain adequate reliability.

In an attempt to balance the workload of Balancing Authorities with the need for accuracy in the FRM, the standard will require at least 20 samples selected during the course of the year to compute the FRM. Research conducted by the FRSST indicated that a Balancing Authority’s FRM will converge to a reasonably stable value with at least 20 samples.

⁸ Single Event Analysis based on results of Frequency Response Standard Field Trial Analysis, September 17, 2012.


Frequency Response Events as Normalized by FRO

Eastern Interconnection - 2011

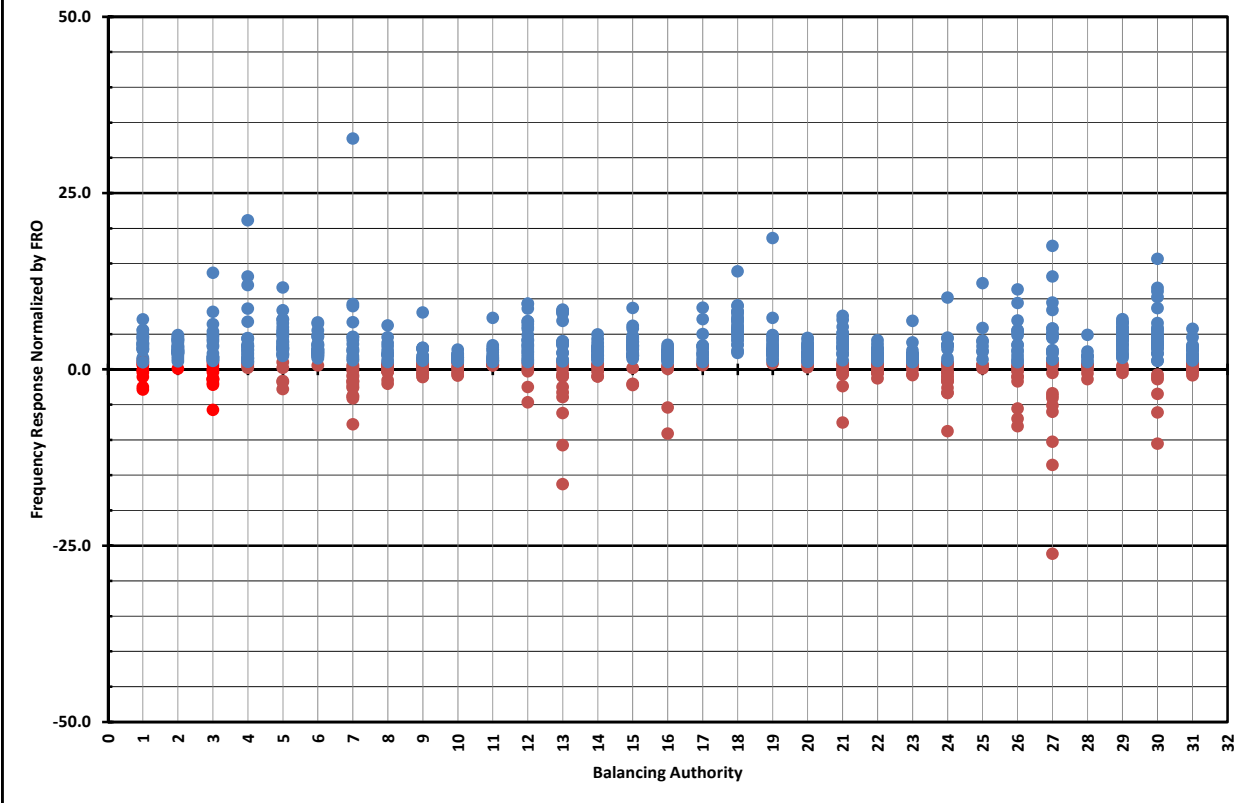


Frequency Response Events as Normalized by FRO

Eastern Interconnection - 2011

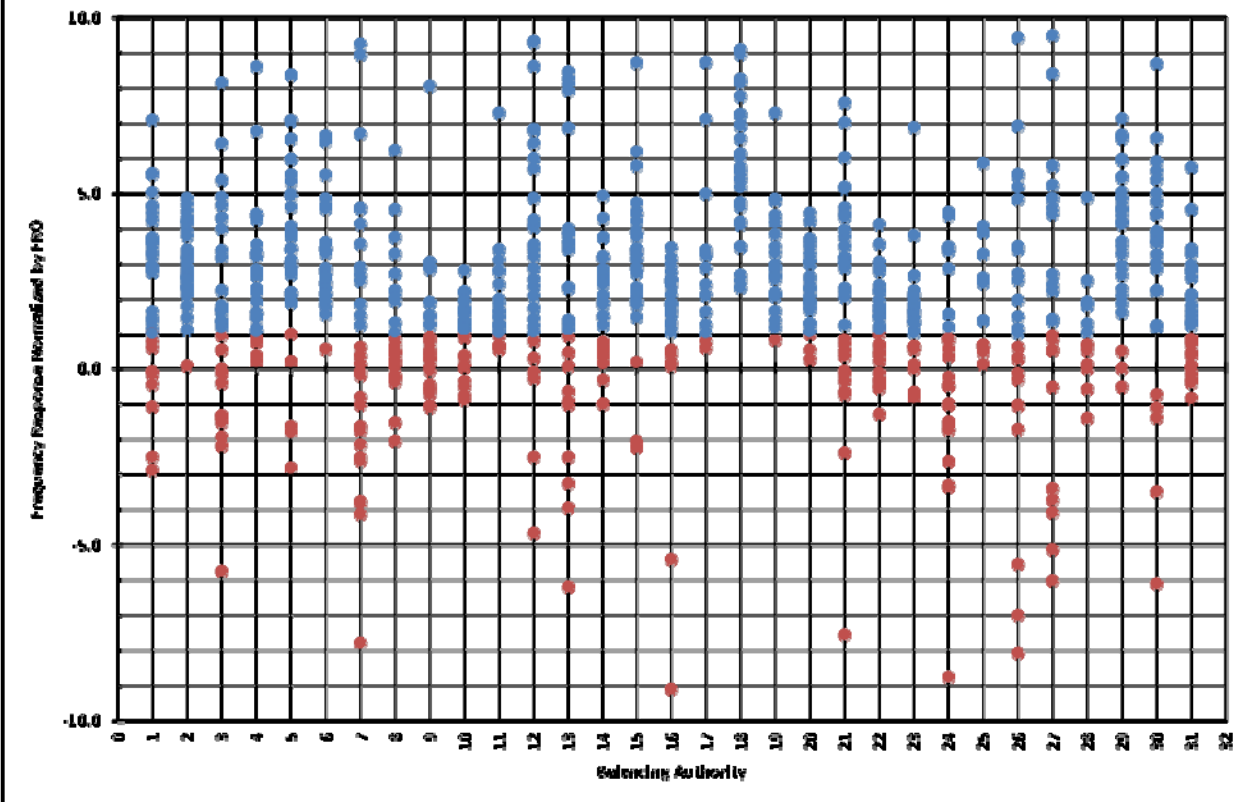


Frequency Response Events as Normalized by FRO

Western Interconnection - 2011

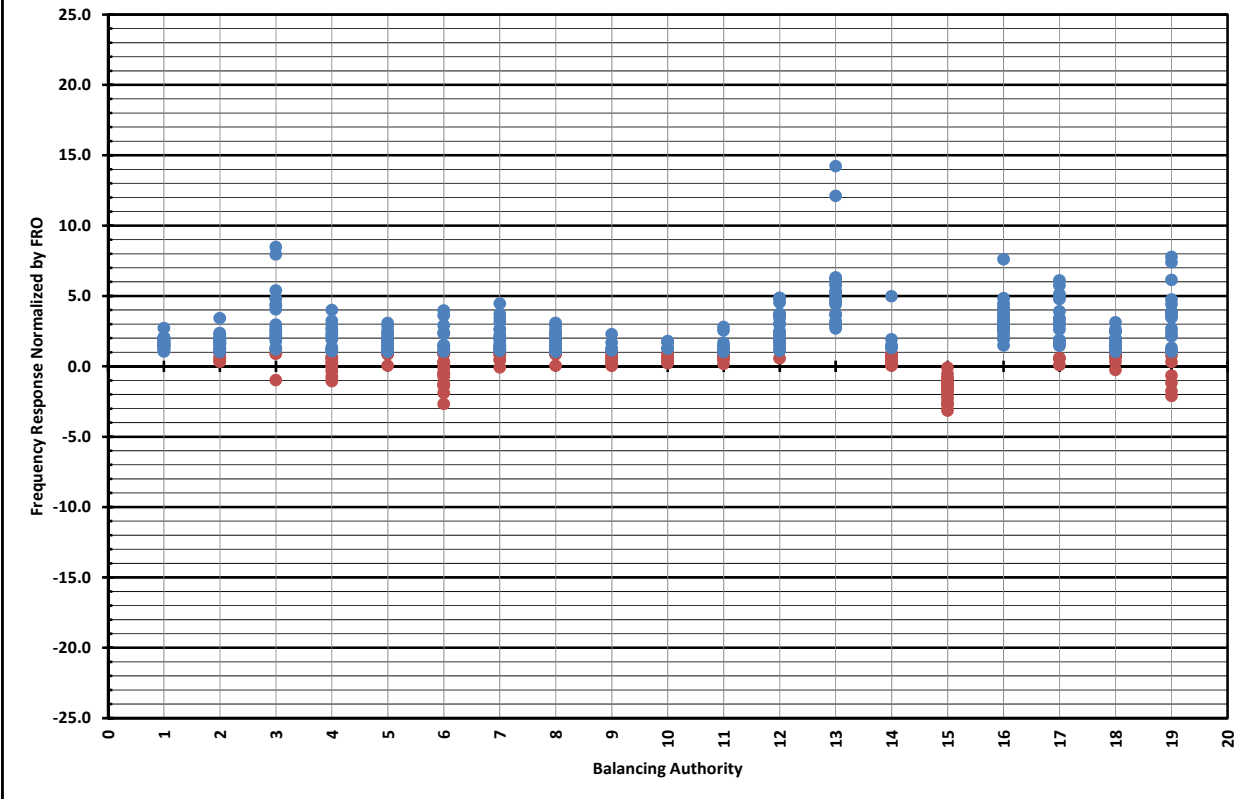

Frequency Response Events as Normalized by FRO

Western Interconnection - 2011

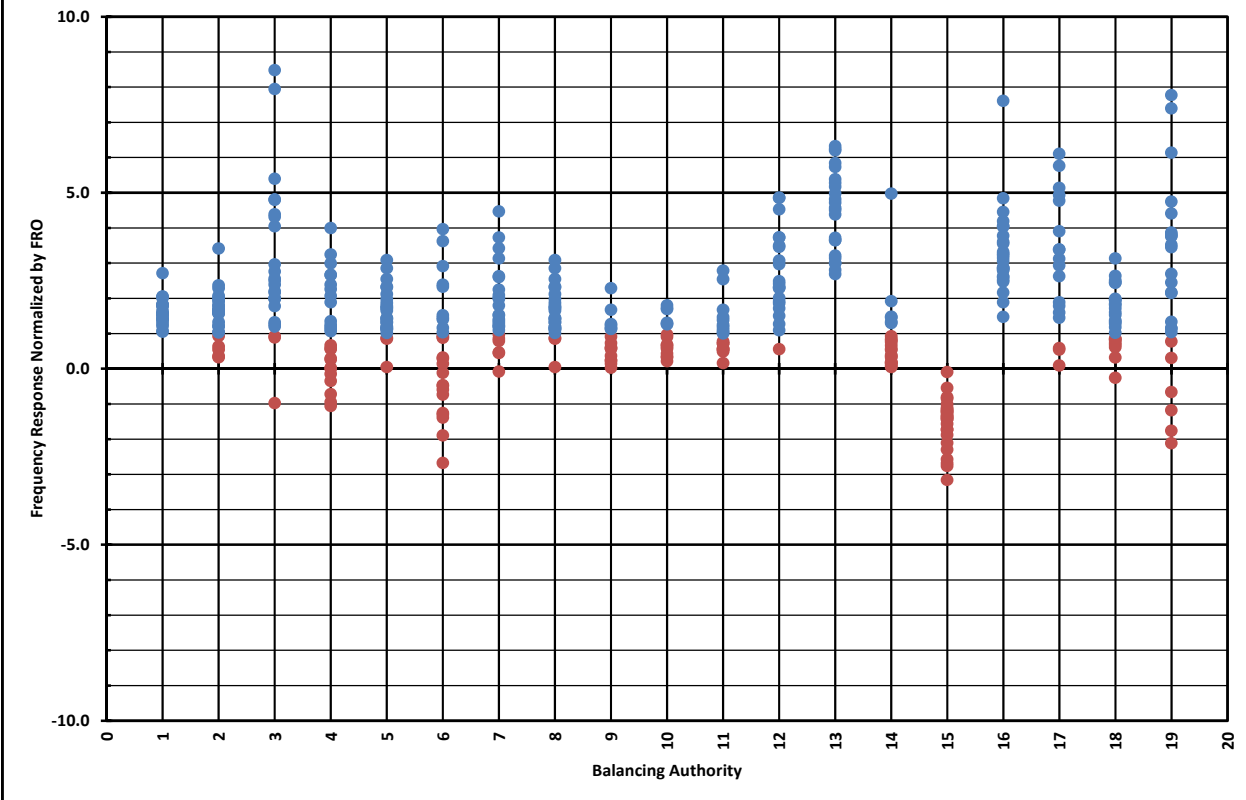

Sample Size

In order to support field trial evaluations of sample size, sampling intervals, and aggregation techniques, the FRSDT will be retrieving scan rate data from the Balancing Authorities for each SEFRD. Additional frequency events may also be requested for research purposes, though they will not be included in the FRM computation.

FERC Order No. 693 directed the ERO (at P 375) to define the number of Frequency Response surveys that were conducted each year and to define a necessary amount of Frequency Response. R1 addresses both of these directives:

- There is a single annual survey of at least 20 events each year.
- The FRM calculated on FRS Form 1 is compared by the ERO against the FRO determined 12 months earlier (when the last FRS Form 1 was submitted) to verify the Balancing Authority provided its share of Interconnection Frequency Response.

Median as the Standard's Measure of Balancing Authority Performance

The FRSDT evaluated different approaches for “averaging” individual event observations to compute a technically sound estimate of Frequency Response Measure. The MW contribution for a single BA in a multi-BA Interconnection is small compared to the minute to minute changes in load, interchange and generation. For example, a 3000 MW BA in the Eastern Interconnection may only be called on to contribute 10MW for the loss of a 1000MW. The 10 MW of governor and load response may easily be masked as a coincident change in load.

In general, statisticians use the median as the best measure of central tendency when a population has outliers. Two independent reviews by the FRSDT has shown the Median to be less influenced by noise in the measurement process and the team has chosen the median as the initial metric for calculating the BAs' Frequency Response Measure.

The FRSDT performed extensive empirical studies and engaged in lively discussions in an attempt to determine the best aggregation technique for a sample set size of at least 20 events. Mean, median, and linear regression techniques were used on a trial basis with the data that was available during the early phases of the effort.

A key characteristic of the “aggregation challenge” is related to the use of actual net interchange data for measuring frequency response. The tie line flow measurements are varying continuously due to other operational phenomena occurring concurrently with the provision of frequency response. (See Appendix 1 for details.) All samples have “noise” in them, as most operational personnel who have computed the frequency response of their BA can attest. What has also become apparent to the FRSDT is that while the majority of the frequency response samples have similar levels of noise in them, a few of the samples may have much larger errors in them than the others that result in unrepresentative results. And with the sample set size of interest, it is common to have unrepresentative errors in these few samples to be very large and asymmetric. For example, one BA's subject matter expert observed recently that 4 out of 31 samples had a much larger error contribution than the other 27 samples, and that 3 out of 4 of the very high error samples grossly underestimated the frequency response. The median value demonstrated greater resiliency to this data quality problem than the mean with this data set. (The median has also demonstrated superiority to

linear regression in the presence of these described data quality problems in other analyses conducted by the FRSDT, but the linear regression showed better performance than the mean.)

The above can be demonstrated with a relatively simple example. Let's assume that a Balancing Authority's true frequency response has an average value of -200 MW/ .1 Hz. Let's also assume that this Balancing Authority installed "special" perfect metering on key loads and generators, so that we could know the true frequency response of each sample. And then we will compare them with that measured by typical tie line flow metering, with the kind of noise and error that occurs commonly and "not so commonly". Let's start with the following 4 samples having a common level of noise, with MW/ .1 Hz as the unit of measurement.

Perfect measurement	Noise	Samples from tie lines
-190	-30	-220
-210	-20	-230
-220	10	-210
-180	20	-160
-200	Mean	-205
-200	Median	-215

Now let's add a fifth sample, which is highly contaminated with noise and error that grossly underestimates frequency response.

Perfect measurement	Noise	Samples from tie lines
-190	-30	-220
-210	-20	-230
-220	10	-210
-180	20	-160
-200	250	+50
-200	Mean	-154
-200	Median	-210

It is clear from the above simplistic example that the mean drops by about 25% while the median is affected minimally by the single highly contaminated value.

Based on the analyses performed thus far, the FRSDT believes that the median's superior resiliency to this type of data quality problem makes it the best aggregation technique at this time. However, the FRSDT sees merit and promise in future research with sample filtering combined with a technique such as linear regression.

When compared with the mean, linear regression shows superior performance with respect to the elimination of noise because the measured data is weighted by the size of the frequency change associated with the event. Since the noise is independent from frequency change, the greater weighting on larger events provides a superior technique for reducing the effect of noise on the results.

However, linear regression does not provide a better method when dealing with a few samples with large magnitudes of noise and unrepresentative error. There are only two alternatives to improve over the use of median when dealing with these larger unrepresentative errors:

1. Increase the sample size, or
2. Actively eliminate outliers due to unrepresentative error.

Unfortunately, the first alternative, increasing the sample size is not available because significantly more sample events are not available within the measurement time period of one year. Linear regression techniques are being investigated that have an active outlier elimination algorithm that would eliminate data that lie outside ranges of the 96th percentile and 99th percentile, for example.

Still, the use of linear regression has value in the context of this standard. The NERC Resources Subcommittee will use linear regression to evaluate Interconnection frequency response, particularly to evaluate trends, seasonal impacts, time of day influences, etc. The Good Practices and Tools section of this document outlines how a BA can use linear regression to develop a predictive tool for its operators.

Additional discussion on this topic is contained in “Appendix 1 – Data Quality Concerns Related to the Use of Actual Net Interchange Value” of this document.

The NERC Frequency Response Initiative Report addressed the relative merits of using the median versus linear regression for aggregating single event frequency response samples into a frequency response measurement score for compliance evaluation. This report provided 11 evaluation criteria as a basis for recommending the use of linear regression instead of the median for the frequency response measurement aggregation technique. The FRSDT made its own assessment on the basis of these evaluation criteria on September 20, 2012, but concluded that the median would be the best aggregation technique to use initially when the relative importance of each criterion was considered. A brief summary of the FRSDT majority consensus on the basis of each evaluation criterion is provided below.

- Provides two dimensional measurement – The FRSDT agrees that the two dimensional concept is a useful way to perceive frequency response characteristics, and that it may be useful for potential future modeling activities. Better data quality would increase support for such future efforts, and the use of the median for initial compliance evaluations within BAL-003-1 should not hinder any such effort. The FRSDT perceived this as a mild advantage for linear regression.
- Represents nonlinear characteristics – With considerations similar to those applied to the previous criterion, the FRSDT perceived this as a mild advantage for linear regression.
- Provides a single best estimator – The FRSDT gave minimal importance to the characteristic of the median averaging the middle values when used with an even number of samples.
- Is part of a linear system - With considerations similar to those applied to the first two criteria, the FRSDT perceived this as a mild advantage for linear regression (particularly in the modeling area.)
- Represents bimodal distributions – The FRSDT gave minimal weight of this criterion, as a change in Balancing Authority footprint does not seem to be addressed adequately by any aggregation technique.
- Quality statistics available – The FRSDT perceived this as a mild advantage for linear regression in that the statistics would be coupled directly to the compliance evaluation. The FRSDT also included this criterion as part of the modeling advantages cited above.

The FRSDT supports collecting data and performing quality statistical analysis. If it is determined that the use of the median, as opposed to a mean or linear regression aggregation, is yielding undesirable consequences, the FRSDT recommends that other aggregation techniques be re-evaluated at that time.

- Reducing influence of noise - This is the dominant concern of the FRSDT, and it perceives the median to have a major advantage over linear regression in addressing noise in the change in actual net interchange calculation. The FRSDT bases this judgment on: prior FRSDT studies that have shown that the median produces more stable results; the data used in the NERC Frequency Response Initiative document exhibits large quantities of noise; prior efforts of FRSDT members in performing frequency response sampling for their own Balancing Authorities over many years; and similar observations of noise in the CERTS frequency Monitoring Application. The FRSDT has serious concerns that the influence of noise has a greater tendency to yield a “false positive” compliance violation with linear regression than with the median. Also, limited studies performed by the FRSDT indicates the possibility that the resultant frequency response measure would yield more measurement variation across years with linear regression versus the median while the actual Balancing Authority performance remains unchanged.
- Reducing the influence of outliers – This is related to the previous criterion. The FRSDT recognizes four main sources of noise: concurrent operating phenomena (described elsewhere in this document), transient tie line flows for nearby contingencies, data acquisition time skew in tie line data measurements, and time skew and data compression issues in archiving techniques and tools such as PI. Some outliers may be caused in part by true variation in the actual frequency response, and it is desirable to include those in the frequency response measure. The FRSDT supports efforts in the near future to distinguish between outliers caused by noise versus true frequency response, and progress in this area may make it feasible and desirable to replace the median with linear regression, or some other validated technique. The FRSDT does note that this is a substantial undertaking, and it would require substantial input from a sufficient number of experts to help distinguish noise from true frequency response.
- Easy to calculate – The FRSDT perceives this to be a minor to moderate advantage for the median. However, more complex (but reasonably so) techniques would receive more support if clear progress can be made in noise elimination.
- Familiar indicator – The FRSDT perceives this to be a minor to moderate advantage for the median. However, more complex (but reasonably so) techniques would receive more support if clear progress can be made as a result of noise elimination.
- Currently used as a measure in BAL-003 – The present standard refers to an average and does not provide specific guidance on the computation of that average, but the FRSDT puts minimal weight on this evaluation criterion.

In summary, the FRSDT perceives an approximate balance between the modeling advantage for linear regression and the simplicity advantage of the median. However, the clear determinant in endorsing the use of the median is the data quality issue related to concurrent operational phenomena, transient tie line flows, and data acquisition and archiving limitations.

FERC Order No. 693 also directed the Standard (at P 375) to identify methods for Balancing Authorities to obtain Frequency Response. Requirement R1 allows Balancing Authorities to participate in Frequency Response Sharing Groups (FRSGs) to provide or obtain Frequency Response. These may be the same FRSGs that cooperate for BAL-002-0 or may be FRSGs that form for the purposes of BAL-003-1.

If BAs participate as an FRSG for BAL-003-1, compliance is based on the sum of the participants' performance.

Two other ways that BAs could obtain Frequency Response are through Supplemental Service or Overlap Regulation Service:

- No special action is needed if a BA provides or receives supplemental regulation. If the regulation occurs via Pseudo Tie, the transfer occurs automatically as part of Net Actual Interchange (NIA) and in response to information transferred from recipient to provider.
- If a BA provides overlap regulation, its FRS Form 1 will include the Frequency Bias setting as well as peak load and generation of the combined Balancing Authority Areas. The FRM event data will be calculated on the sum of the provider's and recipient's performance.

In the Violation Severity Levels for Requirement R1, the impact of a BA not having enough frequency response depends on two factors:

- Does the Interconnection have sufficient response?
- How short is the BA in providing its FRO?

The VSL takes these factors into account. While the VSLs look different than some other standards, an explanation would be helpful.

VSLs are a starting point for the enforcement process. The combination of the VSL and VRF is intended to measure a violation's impact on reliability and thus levy an appropriate sanction. Frequency Response is an interconnection-wide resource. The proposed VSLs are intended to put multi-BA Interconnections on the same plane as single-BA Interconnections.

Consider a small BA whose performance is 70% of its FRO. If all other BAs in the Interconnection are compliant, the small BA's performance has negligible impact on reliability, yet would be sanctioned at the same level as a BA who was responsible for its entire Interconnection. It is not rational to sanction this BA the same as a single BA Interconnection that had insufficient Frequency Response, because this would treat multi-BA Interconnections more harshly than single BA Interconnections on a significant scale.

The "Lower" and "Medium" VSLs say that the Interconnection has sufficient Frequency Response but individual BAs are deficient by small or larger amounts respectively. The High and Severe VSLs say the Interconnection does not meet the FRO and assesses sanctions based on whether the BA is deficient by a small or larger amount respectively.

Requirement 2

R2. Each Balancing Authority that is a member of a multiple Balancing Authority Interconnection and is not receiving Overlap Regulation Service and uses a fixed Frequency Bias Setting shall implement the Frequency Bias Setting determined in accordance with Attachment A, as validated by the ERO, into its Area Control Error (ACE) calculation during the implementation period specified by the ERO.

Background and Rationale

Attachment A of the Standard discusses the process the ERO will follow to validate the BA's FRS Form 1 data and publish the official Frequency Bias Settings. Historically, it has taken multiple rounds of validation and outreach to confirm each BA's data due to transcription errors, misunderstanding of instructions, and other issues. While BAs historically submit Bias Setting data by January 1, it often takes one or more months to complete the process.

The target is to have BAs submit their data by January 10. The BAs are given 30 days to assemble their data since the BAs are dependent on the ERO to provide them with FRS Form 1, and there may be process delays in distributing the forms since they rely on identification of frequency events through November 30 of the preceding year.

Frequency Bias Settings generally change little from year to year. Given the fact that BAs can encounter staffing or EMS change issues coincident with the date the ERO sets for new Frequency Bias Setting implementation, the standard provides a 24 hour window on each side of the target date.

To recap the annual process:

1. The ERO posts the official list of frequency events to be used for this Standard in early December. The FRS Form 1 for each Interconnection will be posted shortly thereafter.
2. The Balancing Authority submits its revised annual Frequency Bias Setting value to NERC by January 10.
3. The ERO and the Resources Subcommittee validate Frequency Bias Setting values, perform error checking, and calculate, validate, and update CPS2 L10 values. This data collection and validation process can take as long as two months.
4. Once the L10 and Frequency Bias Setting values are validated, The ERO posts the values for the upcoming year and also informs the Balancing Authorities of the date on which to implement revised Frequency Bias Setting values. Implementation typically would be on or about March 1st of each year.

BAL-003-0.1b standard requires a minimum Frequency Bias Setting equal in absolute value to one percent of the Balancing Authority's estimated yearly peak demand (or maximum generation level if native load is not served). For most Balancing Authorities this calculated amount of Frequency Bias is significantly greater in absolute value than their actual Frequency Response characteristic (which represents an over-bias condition) resulting in over-control

since a larger magnitude response is realized. This is especially true in the Eastern Interconnection where this condition requires excessive secondary frequency control response which degrades overall system performance and increases operating cost as compared to requiring an appropriate balance of primary and secondary frequency control response.

Balancing Authorities were given a minimum Frequency Bias Setting obligation because there had never been a mandatory Frequency Response Obligation. This historic “one percent of peak per 0.1Hz” obligation, dating back to NERC’s predecessor, NAPSIC, was intended to ensure all BAs provide some support to Interconnection frequency.

The ideal system control state exists when the Frequency Bias Setting of the Balancing Authority exactly matches the actual Frequency Response characteristic of the Balancing Authority. If this is not achievable, over-bias is significantly better from a control perspective than under-bias with the caveat that Frequency Bias is set relatively close in magnitude to the Balancing Authority actual Frequency Response characteristic. Setting the Frequency Bias to better approximate the Balancing Authority natural Frequency Response characteristic will improve the quality and accuracy of ACE control, CPS & DCS and general AGC System control response. This is the technical basis for recommending an adjustment to the long standing “1% of peak/0.1Hz” Frequency Bias Setting. The Procedure for ERO Support of Frequency Response and Frequency Bias Setting Standard is intended to bring the Balancing Authorities’ Frequency Bias Setting closer to their natural Frequency Response. Procedure for ERO Support of Frequency Response and Frequency Bias Setting Standard balances the following objectives:

- Bring the Frequency Bias Setting and Frequency Response closer together.
- Allow time to analyze impact on other Standards (CPS, BAAL and to a lesser extent DCS) by adjustments in the minimum Frequency Bias Setting, by accommodating only minor adjustments.
- Do not allow the Frequency Bias Setting minimum to drop below natural Frequency Response, because under-biasing could affect an Interconnection adversely.

Additional flexibility has been added to the Frequency Bias Setting based on the actual Frequency Response (FRM) by allowing the Frequency Bias Setting to have a value in the range from 100% of FRM to 125% of FRM. This change has been included for the following reasons:

- When the new standardized measurement method is applied to BAs with a Frequency Response close to the interconnection minimum response, the requirement to use FRM is as likely to result in a Frequency Bias Setting below the actual response as it is to result in a response above the actual response. From a reliability perspective, it is

always better to have a Frequency Bias Setting slightly above the actual Frequency Response.

- As with single BA interconnections, the tuning of the control system may require that the BA implement a Frequency Response Setting slightly greater in absolute terms than its actual Frequency Response to get the best performance.
- The new standardized measurement method for determining FRM in some cases results in a measured Frequency Response significantly lower than the previous methods used by some BAs. It is desirable to not require significant change in the Frequency Bias Setting for these BAs that experience a reduction in their measured Frequency Response.

Requirement 3

R3. Each Balancing Authority that is a member of a multiple Balancing Authority Interconnection, is not receiving Overlap Regulation Service and utilizing a variable Frequency Bias Setting shall maintain a Frequency Bias Setting that is:

- *Less than zero at all times, and*
- *Equal to or more negative than its Frequency Response Obligation when the Frequency varies from 60 Hz by more than +/- 0.036 Hz.*

Background and Rationale

In multi-Balancing Authority interconnections, the Frequency Bias Setting should be coordinated among all BAs on the interconnection. When there is a minimum Frequency Bias Setting requirement, it should apply for all BAs. However, BAs using a variable Frequency Bias Setting may have non-linearity in their actual response for a number of reasons including the dead-bands implemented on their generator governors. The measurement to ensure that these BAs are conforming to the interconnection minimum is adjusted to remove the dead-band range from the calculated average Frequency Bias Setting actually used. For BAs using variable bias, FRS Form 1 has a data entry location for the previous year's average monthly Bias. The Balancing Authority and the ERO can compare this value to the previous year's Frequency Bias Setting minimum to ensure R3 has been met.

On single BA interconnections, there is no need to coordinate the Frequency Bias Setting with other BAs. This eliminates the need to maintain a minimum Frequency Bias Setting for any reason other than meeting the reliability requirement as specified by the Frequency Response Obligation.

Requirement 4

R4. Each Balancing Authority that is performing Overlap Regulation Service shall modify its Frequency Bias Setting in its ACE calculation, in order to represent the Frequency Bias Setting for the combined Balancing Authority Area, to be equivalent to either:

- *The sum of the Frequency Bias Settings as shown on FRS Form 1 and FRS Form 2 for the participating Balancing Authorities as validated by the ERO, or*
- *The Frequency Bias Setting as shown on FRS Form 1 and FRS Form 2 for the entirety of the participating Balancing Authorities' Areas.*

Background and Rationale

This requirement reflects the operating principles first established by NERC Policy 1 and is similar to Requirement R6 of the approved BAL-003-0.1b standard. Overlap Regulation Service is a method of providing regulation service in which the Balancing Authority providing the regulation service incorporates another Balancing Authority's actual interchange, frequency response, and schedules into the providing Balancing Authority's AGC/ACE equation.

As noted earlier, a BA that is providing Overlap Regulation will report the sum of the Bias Settings in its FRS Form 1. Balancing Authorities receiving Overlap Regulation Service have an ACE and Frequency Bias Setting equal to zero (0).

How this Standard Meets the FERC Order No. 693 Directives

FERC Directive

The following is the relevant paragraph of Order No. 693.

Accordingly, the Commission approves Reliability Standard BAL-003-0 as mandatory and enforceable. In addition, the Commission directs the ERO to develop a modification to BAL-003-0 through the Reliability Standards development process that: (1) includes Levels of Non-Compliance; (2) determines the appropriate periodicity of frequency response surveys necessary to ensure that Requirement R2 and other requirements of the Reliability Standard are being met, and to modify Measure M1 based on that determination and (3) defines the necessary amount of Frequency Response needed for Reliable Operation for each balancing authority with methods of obtaining and measuring that the frequency response is achieved.

1. Levels of Non-Compliance

VRFs and VSLs are an equally effective way of assigning compliance elements to the standard.

2. Determine the appropriate periodicity of frequency response surveys necessary to ensure that Requirement R2 and other Requirements of the Reliability Standard are met

BAL-003 V0 R2 (the basis of Order No. 693) deals with the calculation of Frequency Bias Setting such that it reflects natural Frequency Response.

The drafting team has determined that a sample size on the order of at least 20 events is necessary to have a high confidence in the estimate of a BA's Frequency Response. Selection of the frequency excursion events used for analysis will be done via a method outlined in Attachment A to the Standard.

On average, these events will represent the largest 2-3 "clean" frequency excursions occurring each month.

Since Frequency Bias Setting is an annual obligation, the survey of the at least 20 frequency excursion events will occur once each year.

3. Define the necessary amount of Frequency Response needed for Reliable Operation for each Balancing Authority with methods of obtaining and measuring that the frequency response is achieved

Necessary Amount of Frequency Response

The drafting team has proposed the following approach to defining the necessary amount of frequency response. In general, the goal is to avoid triggering the first step of under-frequency load shedding (UFLS) in the given Interconnection for reasonable contingencies expected. The

methodology for determining each Interconnection's and Balancing Authority's obligation is outlined in Attachment A to the Standard.

It should be noted the standard cannot guarantee there will never be a triggering of UFLS as the magnitude of "point C" differs throughout an interconnection during a disturbance and there are local areas that see much wider swings in frequency.

The contingency protection criterion is the largest reasonably expected contingency in the Interconnection. This can be based on the largest observed credible contingency in the previous 10 years or the largest Category C event for the Interconnection.

Attachment A to the standard presents the base obligation by Interconnection and adds a Reliability Margin. The Reliability Margin included addresses the difference between Points B and C and accounts for variables.

For multiple BA interconnections, the Frequency Response Obligation is allocated to BAs based on size. This allocation will be based on the following calculation:

$$FRO_{BA} = FRO_{Int} \times \frac{\text{Annual Gen}_{BA} + \text{Annual Load}_{BA}}{\text{Annual Gen}_{Int} + \text{Annual Load}_{Int}}$$

Methods of Obtaining Frequency Response

The drafting team believes the following are valid methods of obtaining Frequency Response:

- Regulation services.
- Contractual service. The drafting team has developed an approach to obtain a contractual share of Frequency Response from Adjacent Balancing Authorities. See FRS Form 1. While the final rules with regard to contractual services are being defined, the current expectation is that the ERO and the associated Region(s) should be notified beforehand and that the service be at least 6 months in duration.
- Through a tariff (e.g. Frequency Response and regulation service).
- From generators through an interconnection agreement.
- Contract with an internal resource or loads (The drafting team encourages the development of a NAESB business practice for Frequency Response service for linear (droop) and stepped (e.g. LaaR in Texas) response).

Since NERC standards should not prescribe or preclude any particular market related service, BAs and FRSGs may use whatever is most appropriate for their situation.

Measuring that the Frequency Response is Achieved

FRS Form 1 and the underlying data retained by the BA will be used for measuring whether Frequency Response was provided. FRS Form 1 will provide the guidance on how to account for and measure Frequency Response.

Going Beyond the Directive

Based on the combined operating experience of the SDT, the drafting team consensus is that each Interconnection has sufficient Frequency Response. If margins decline, there may be a need for additional standards or tools. The drafting team and the Resources Subcommittee are working with the ERO on its Frequency Response Initiative to develop processes and good practices so the Interconnections are prepared. These good practices and tools are described in the following section.

The drafting team is also evaluating a risk-based approach for basing the Interconnection Frequency Response Obligation on an historic probability density of frequency error, and for allocating the obligation on the basis of the Balancing Authority's average annual ACE share of frequency error. This allocation method uses the inverse of the rationale for allocating the CPS1 epsilon requirement by Bias share.

Good Practices and Tools

Background

This section outlines tips and tools to help Balancing authorities meet the Frequency Response Standard or to operate more reliably. If you have suggested additions, please send them to balancing@nerc.com.

Identifying and Estimating Frequency Responsive Reserves

Knowing the quantity and depth of frequency responsive reserves in real time is a possible next step to being better prepared for the next event. The challenge in achieving this is having the knowledge of the capabilities of all sources of frequency response. Presently the primary source of Frequency Response remains with the generation resources in our fleets.

Understanding how each of these sources performs to changes in system frequency and knowing their limitations would improve the BA's ability to measure frequency responsive reserves. Presently there are only guidelines, criteria and protocols in some regions of the industry that identify specific settings and performance expectations of Primary Frequency Response of resources.

One method of gaining a better understanding of performance is to measure performance during actual events that occur on the system. Measuring performance during actual events would only provide feedback for performance during that specific event and would not provide insight into depth of response or other limitations.

Repeated measurements will increase confidence in expected performance. NERC modeling standards are in process to be revised that will improve the BA's insight into predicting available frequency responsive reserves. However, knowing how resources are operated, what modes of operation provide sustained Primary Frequency Response and knowing the operating range of this response would give the BA the knowledge to accurately predict frequency response and the amount of frequency responsive reserves available in real time.

Some benefits have been realized by communicating to generation resources (GO) the importance of operating in modes that allow Primary Frequency Response to be sustained by the control systems of the resource. Other improvements in implementation of Primary Frequency Response have been achieved through improved settings on turbine governors through the elimination of "step" frequency response with the simultaneous reduction in governor dead-band settings.

Improvements in the full AGC control loop of the generating resource, which accounts for the expected Primary Frequency Response, have improved the delivery of quality Primary Frequency Response while minimizing secondary control actions of generators. Some of these actions can provide quick improvement in delivery of Primary Frequency Response.

Once Primary Frequency Response sources are known, the BA could calculate available reserves that are frequency responsive. Planning for these reserves during normal and emergency operations could be developed and added to the normal planning process.

Using FRS Form 1 Data

The information collected for this standard can be supplemented by a few data points to provide the Balancing Authority useful tools and information. The BA could do a regression analysis of its frequency response against the following values:

- Load (value A).
- Interchange (Value A).
- Total generation.
- Spinning reserve.

While the last two values above are not part of Form 1, they should be readily available. Small BAs might even include headroom on its larger generators as part of the regression.

The regression would provide a formula the BA could program in its EMS to present the operator a real time estimate of the BA's Frequency Response.

Statistical outliers in the regression would point to cases meriting further inspection to find causes of low Frequency Response or opportunities for improvement.

Tools

Single generating resource performance evaluation tools for steam turbine, combustion turbine (simple cycle or combined cycle) and for intermittent resources are available at the following link. http://texasre.org/standards_rules/standardsdev/rsc/sar003/Pages/Default.aspx.

These tools and the regional standard associated with them are in their final stages of development in the Texas region.

These tools will be posted on the [NERC website](#).

References

NERC *Frequency Response Characteristic Survey Training Document* (Found in the NERC [Operating Manual](#))

[NERC Resources Subcommittee Position Paper on Frequency Response](#)

NERC TIS Report [Interconnection Criteria for Frequency Response Requirements \(for the Determination Interconnection Frequency Response Obligations \(IFRO\)](#)

Frequency Response Standard Field Trial Analysis, September 17, 2012

Appendix 1 - Data Quality Concerns Related To The Use Of The Actual Net Interchange Value

Actual net interchange for a typical Balancing Authority (BA) is the summation of its tie lines to other BAs. In some cases, there are pseudo-ties in it which reflect the effective removal or addition of load and/or generation from another BA, or it could include supplemental regulation as well. But in the typical scenario, actual net interchange values that are extracted from EMS data archiving can be influenced by data latency times in the data acquisition process, and also any timestamp skewing in the archival process.

Of greater concern, however, are the inevitable variations of other operating phenomena occurring concurrently with a frequency event. The impacts of these phenomena are superimposed on actual net interchange values along with the frequency response that we wish to measure through the use of the actual net interchange value.

To explore this issue further, let's begin with the idealized condition:

- frequency is fairly stable at some value near or a little below 60 Hz
- ACE of the non-contingent BA of interest is 0 and has been 0 for an extended period, and AGC control signals have not been issued recently
- Actual net interchange is "on schedule", and there are no schedule changes in the immediate future
- BA load is flat
- All generators not providing AGC are at their targets
- Variable generation such as wind and solar are not varying
- Operators have not directed any manual movements of generation recently

And when the contingency occurs in this idealized state, the change in actual net interchange will be measuring only the decline in load due to lesser frequency and generator governor response, and, none of the contaminating influences. While the ACE may become negative due to the actual frequency response being less than that called for by the frequency bias setting within the BA's AGC system, this contaminating influence on measuring frequency response will not appear in the actual net interchange value if the measurement interval ends before the generation or AGC responds.

Now let's explore the sensitivity of the resultant frequency response sampling to the relaxation of these idealized circumstances.

1. The "60 Hz load" increases moderately due to time of day concurrent with the frequency event. If the frequency event happens before AGC or operator-directed manual load adjustments occur, then the actual net interchange will be reduced by the moderate increase in load and the frequency response will be underestimated. But if the frequency event happens while AGC response and/or manual adjustments occur, then the actual net interchange will be increased by the AGC response (and/or manual adjustments) and the frequency response will be overestimated.

2. The “60 Hz load” decreases moderately due to time of day concurrent with the frequency event. If the frequency event happens before AGC or operator-directed manual load adjustments occur, then the actual net interchange will be increased by the moderate reduction in load and the frequency response will be overestimated. But if the frequency event happens while AGC response and/or manual adjustments occur, then the actual net interchange will be decreased by the AGC response (and/or manual adjustments) and the frequency response will be underestimated.
3. In anticipation of increasing load during the next hour, the operator increases manual generation before the load actually appears. If the frequency event happens while the generation “leading” the load is increasing, then the actual net interchange will be increased by the increase in manual generation and the frequency response will be overestimated. But if the frequency event occurs when the result of AGC signals sent to offset the operator’s leading actions take effect, then the actual net interchange will be decreased and the frequency response is underestimated.
4. In anticipation of decreasing load during the next hour, the operator decreases manual generation before the load actually declines. If the frequency event happens while the generation “leading” the load downward is decreasing, then the actual net interchange will be decreased by the reduction in manual generation and the frequency response will be underestimated. But if the frequency event occurs when the result of AGC signals sent to offset the operator’s leading actions take effect, then the actual net interchange will be increased and the frequency response is overestimated.
5. A schedule change to export more energy is made at 5 minutes before the top of the hour. The BA’s “60 Hz load” is not changing. The schedule change is small enough that the operator is relying on upward movement of generators on AGC to provide the additional energy to be exported. The time at which the AGC generators actually begin to provide the additional energy is dependent on how much time passes before the AGC algorithm gets out of its deadbands, the individual generator control errors get large enough for sending out the control signal, and maybe 20 seconds to 3 minutes for the response to be effected. The key point here is that it is not clear when the effects of a schedule change, as manifested in a change in generation and then ultimately a change in actual net interchange, will occur.
6. With the expected penetration of wind in the near future, unanticipated changes in their output will tend to affect actual net interchange and add noise to the frequency response observation process.

To a greater or lesser extent, 1 through 4 above are happening continuously for the most part with most BAs in the Eastern and Western Interconnections. The frequency response is buried within the typical hour to hour operational cacophony superimposed on actual net interchange values. The choice of metrics will be important to artfully extract frequency response from the noise and other unrepresentative error.